
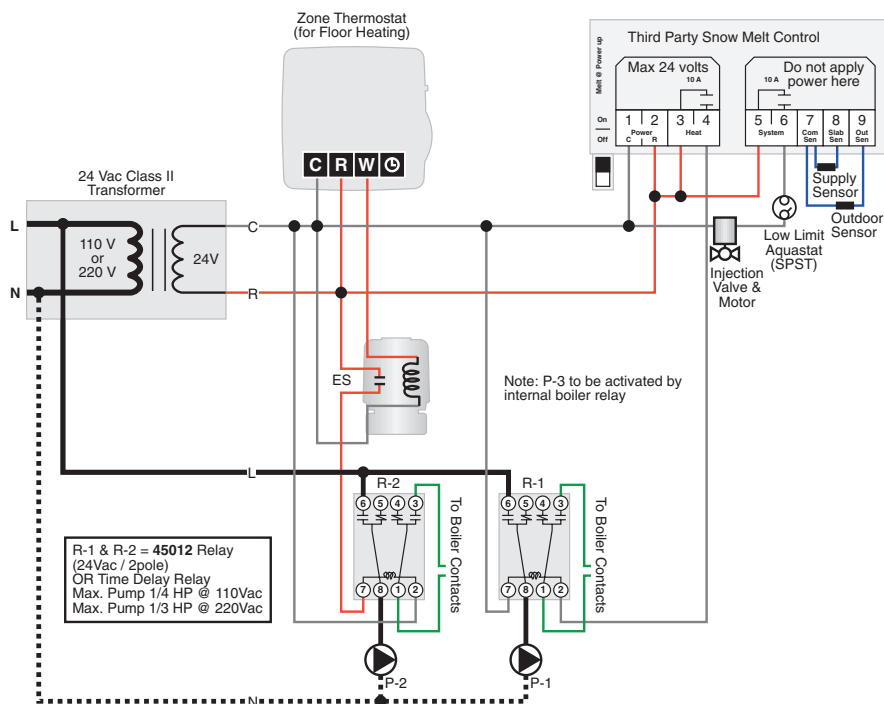


### Application:

Semi-Automatic Snow melt controller c/w slab sensor only activating an injection valve, c/w floor heating zone thermostat activating the system pump through a relay.

(High mass boiler c/w primary and system pumps)

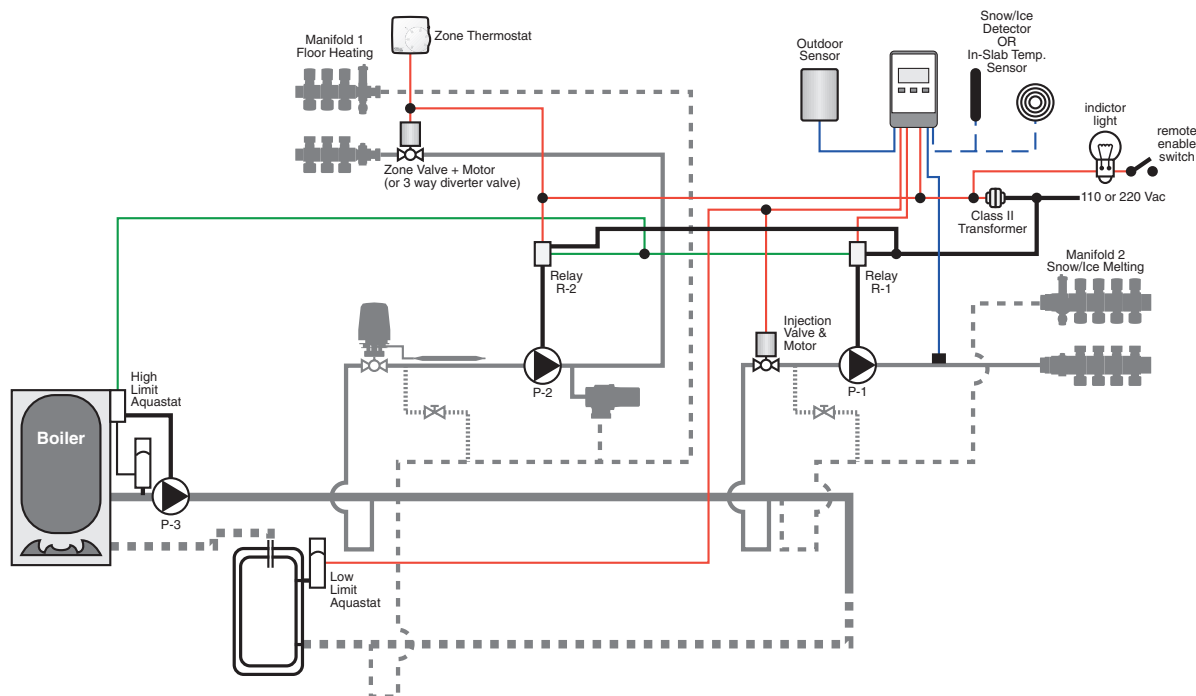

### Note:

- Drawings are for HeatLink® suggested electrical schematics only! User must determine if electrical schematic will work for their particular application. User must also confirm all HeatLink® schematics with manufacturer schematics of each particular control chosen.
- In all cases manufacturer equipment schematics will take precedence over HeatLink® electrical schematics.
- All wiring as per applicable electrical codes!