
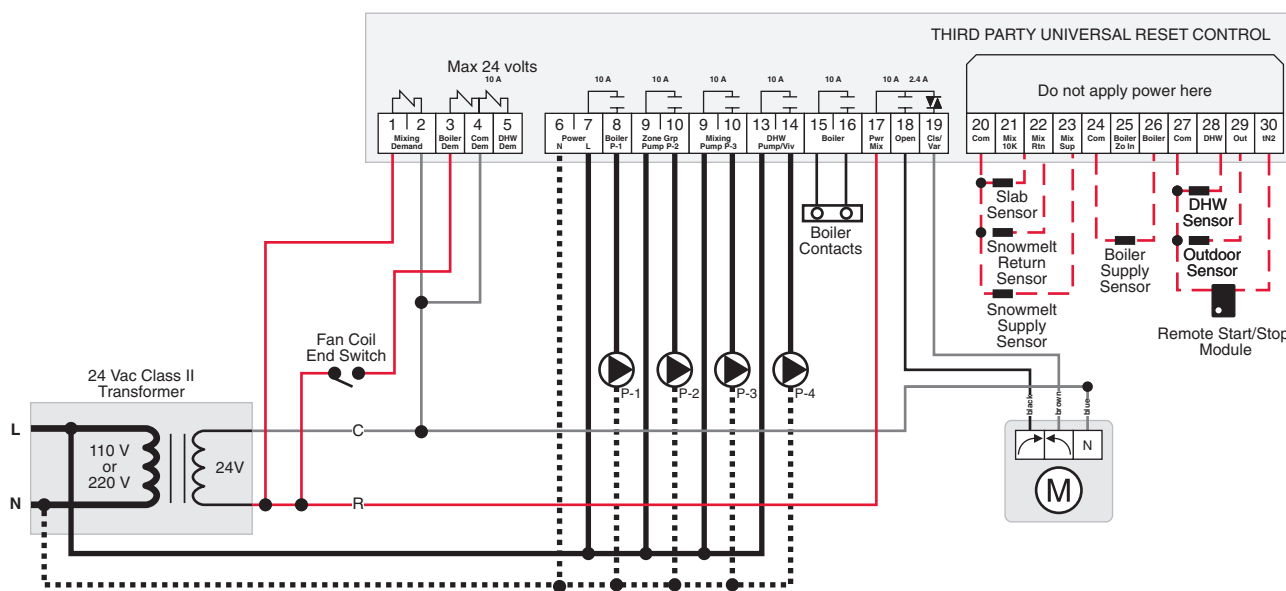


Application:

Semi-automatic snow melt plus high temp system controller c/w slab sensor only activating a 4-way mixing valve motor, plus high temp system pumps.

(High mass boiler c/w heat exchanger plus mixing & system pumps)

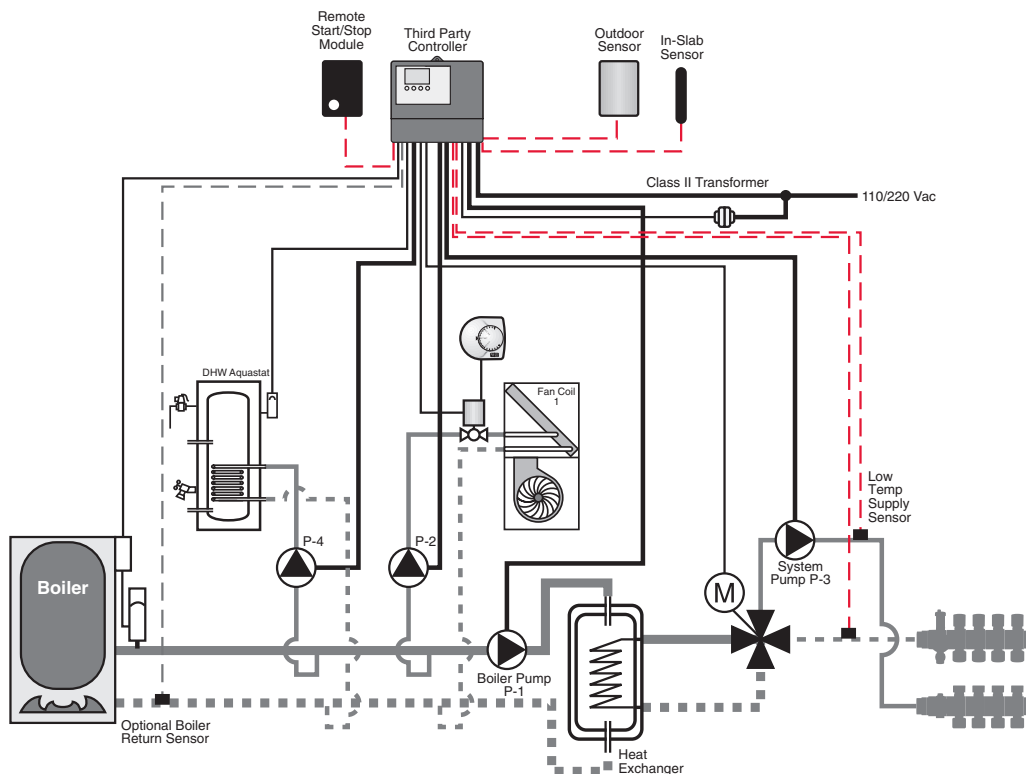

Note: For DHW tank use third party full port zone valve. See ELECT 4.2 for typical wiring

Note:

- Drawings are for HeatLink® suggested electrical schematics only! User must determine if electrical schematic will work for their particular application. User must also confirm all HeatLink® schematics with manufacturer schematics of each particular control chosen.
- In all cases manufacturer equipment schematics will take precedence over HeatLink® electrical schematics.
- All wiring as per applicable electrical codes!