



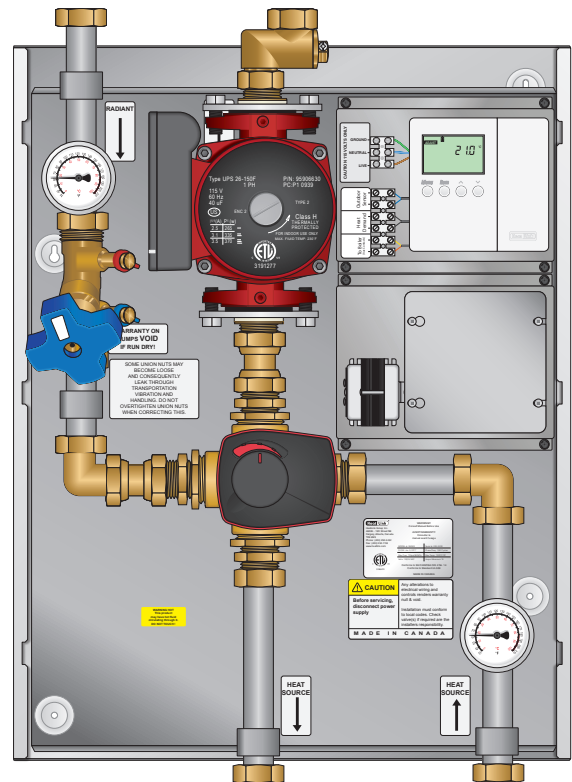

4WMIX

Installation, Operation, and Maintenance Manual

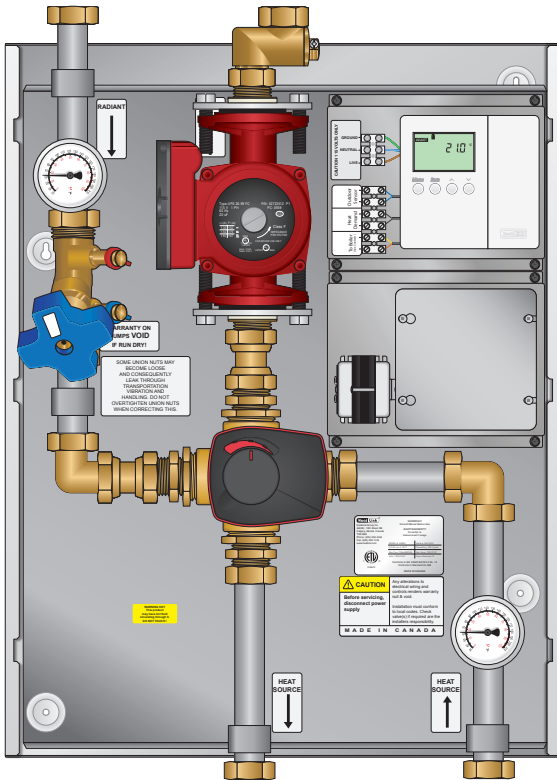

2	Warnings
2	Servicing
2	Tools
3	Function
3	Unpacking
4	Panel Components
5	Panel Components (cont'd)
5	Specifications & Listings
9	Panel Mounting
10	Piping Hookup
11	Fill & Purge
12	Piping Options
13	Panel Wiring
13	Wiring Diagram
14	Panel Control Sequence
15	Mixing Reset Control
15	Technical Data
38	Piping Options
39	Maintenance

Disclaimer

HeatLink Group Inc. shall not be responsible for errors in its brochures or printed materials. HeatLink Group Inc. reserves the right to alter its products at any time without notice, provided that alterations to products already on order shall not require material changes in specifications previously agreed upon HeatLink Group Inc. and the Purchaser. All trademarks in this material are property of the respective companies. HeatLink and the HeatLink logotype are trademarks of HeatLink Group Inc. All rights reserved.

Warnings

The zone control panel is for indoor use only and must be installed by a qualified installer/service technician. This product must be installed and operated in strict accordance with the terms set out in this manual and in accordance with the relevant requirements of the Local Authority Having Jurisdiction. Failure to comply will result in a void of warranty, and may also result in property damage, serious injury, or death.

Servicing

Prior to commencing installation of this panel it is necessary to read and understand all sections of this manual. The symbols below are used throughout this document to ensure proper operation of the panel, and your safety. Please pay attention to these symbols.



Warning
Possible Hazard



Warning
Live Power



Warning
Hot Pipes



Warning
Treated Water



In order to avoid injury or death, switch off the power to the panel prior to inspecting or making connections to the terminal strip.

Tools

- Level
- Screwdriver or power drill
- Flat head bit
- Phillips head bit # 2
- 2 adjustable wrenches (or 2 × 30mm wrenches)

Function

This zone control panel can provide mixing, distribution, and zoning for a wide variety of hydronic heating applications.

The effectiveness of the system is dependant on the system being designed and installed correctly. Proper consideration of factors such as BTU loads, outdoor design temperature, indoor design temperature, room set-point temperature(s), differential fluid temperatures, head loss, flow rates, and transfer capacities of the heat emitters is critical.

Once these factors have been considered and the system requirements determined, these can then be evaluated and compared to the panel capabilities.

Note: This panel does not regulate or monitor the operating safety limit temperatures of the fluid leaving the heat source.

Unpacking


Step 1 Examine carton for any damage that may have occurred during shipping. If damage is visible notify your courier and supplier immediately.

Step 2 Open the carton by removing the staples.


Step 3 Remove the cardboard spacers from the carton, then remove the panel from the carton. Lift the panel by the base, not the enclosure.

Step 4 There are 2 screws holding the enclosure in place during shipping. They are located at the top left & right of the panel base. Remove these 2 screws.

Step 5 Remove the enclosure from the panel by sliding it upwards until it stops, then gently pulling outwards off.

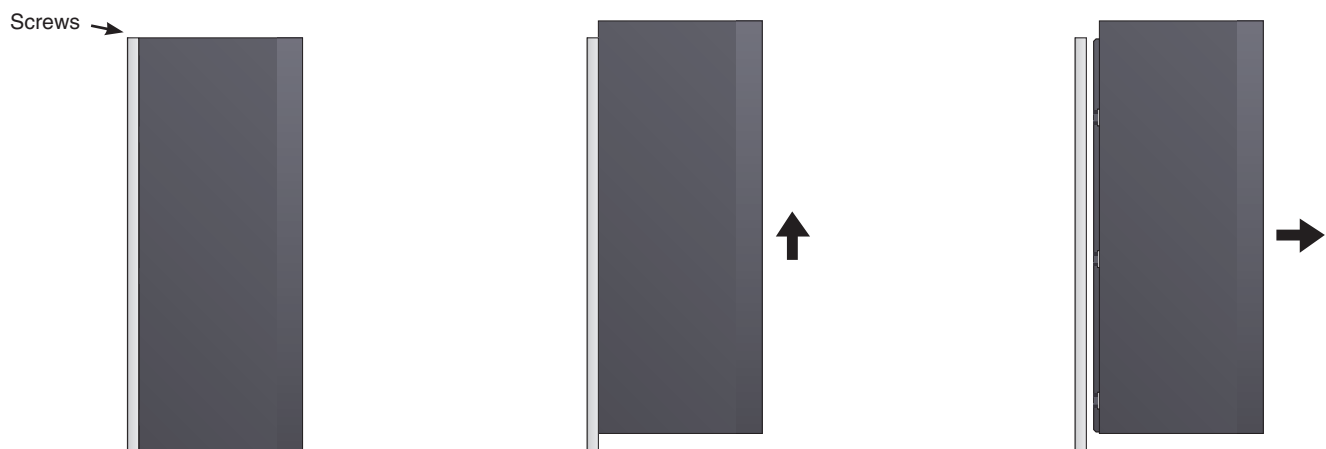

Panel Components

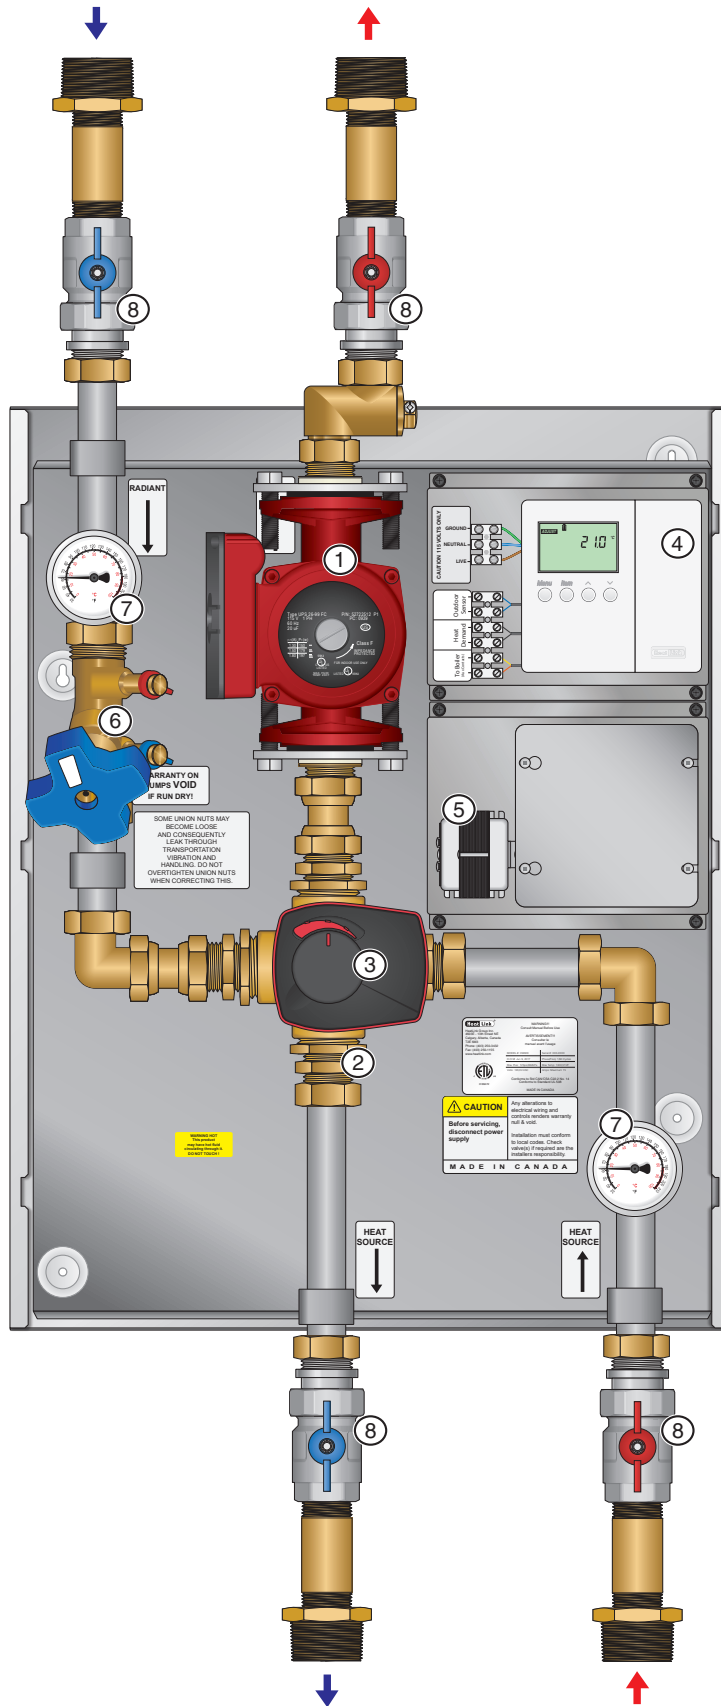

Panel Components (cont'd)

#	Components	Part Number	
		4WMIX	4WMIXHH
1	Secondary pump	UPS26-99	UPS26-150
2	1½" Mixing valve (hidden)		64031
3	Mixing valve motor		58131
4	Mixing reset control		31355
5	24V(ac) transformer		n/a
6	Balancing valve		n/a
7	Thermometer		n/a
8	Isolation valve assemblies*		n/a

*Packaged in accessory box for shipping. See page 10 for piping hookup instructions.

Specifications & Listings

Headings	4WMIX-SMCP	4WMIXHH-SMCP
Listing		cETLus
Conforms to		CAN/CSA-C22 No.14, UL508
Dimensions		24"H × 18¾"W × 8"D
Weight		
Max ambient temperature		120°F
Max water temperature		200°F
Settable fluid temperature range		100-145°F
Power supply	120V(ac)	
Circulator	Ferrous, Grundfos UPS26-99FC	Ferrous, Grundfos UPS26-150FC
Auxiliary terminal		none
Temperature control method		1½" 4-way mixing valve and motor
Temperature control range		
Mixing valve Cv	18.7	
Piping		1" 304 stainless steel tubing, 1" brass
Piping connections		1½" MNPT
Backplate		Galvanized steel
Enclosure		Powder coated steel


Panel Component Specifications

Circulator

The circulator moves the heated fluid through the system when there is a call for heat from the system controller.



The addition of glycol to the system will result in higher demand from the circulator due to the change in viscosity of the fluid.

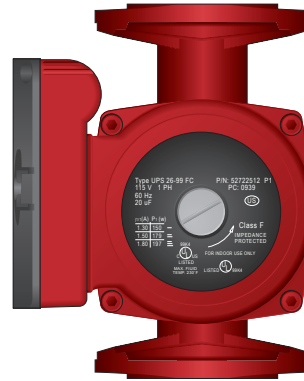


Technical Data - UPS 26-99 FC

Material:

- Inlet cone, bearing plate, bearing retainers, rotor can, rotor cladding, shaft retainer:..... Stainless Steel
- Stator Housing:..... Aluminium
- Shaft, upper and lower radial bearings:..... Aluminium oxide ceramic
- Thrust bearing: Carbon bearing and EPDM retainer
- Check valve: ACETAL with 302 SS spring and nitrile rubber seats
- Pump housing (volute):..... Cast iron
- O-ring and gaskets: EPDM
- Impeller: PES composite (30% glass-filled)
- Terminal box: Noryl® with EPDM gasket
- Flow Range: 0-33 US gpm (0-7.5 m³/h)
- Head Range:..... 0-29 ft (0-8.8 m)
- Motors:..... 2-pole, single-phase
- Max. Liquid Temperature: 230°F (110°C)
- Min. Liquid Temperature: 36°F (2°C)
- Max. System Pressure:..... 145 psi (10 bar)

Speed	Volts	Amps	Watts	Hp	Capacitor
3	115	1.8	197	1/6	20 µF/180V
2		1.5	179	1/6	
1		1.3	150	1/6	

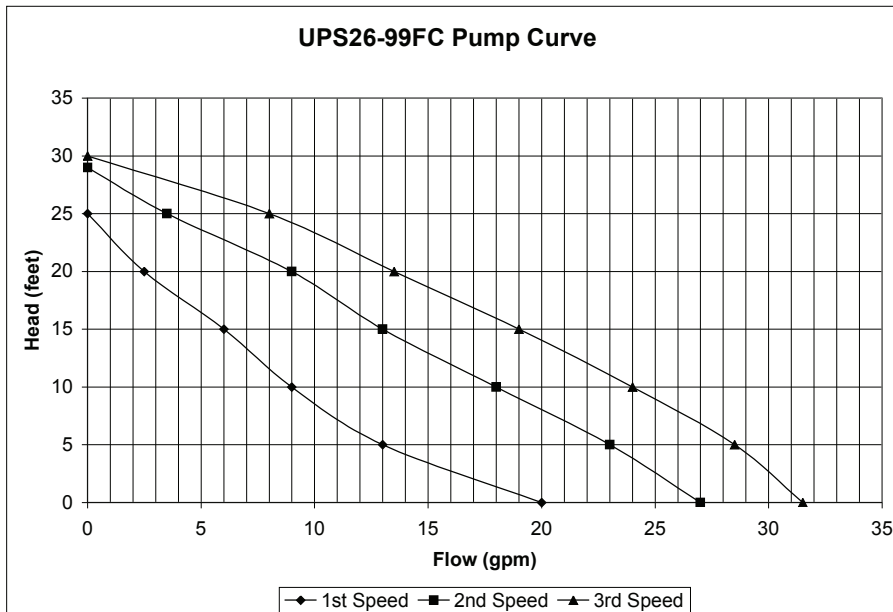


Technical Data - UPS 26-150 FC


Material:

- Inlet cone, bearing plate, bearing retainers, rotor can, rotor cladding, shaft retainer:..... Stainless Steel
- Stator Housing:..... Aluminium
- Shaft, upper and lower radial bearings:..... Aluminium oxide ceramic
- Thrust bearing: Carbon bearing and EPDM retainer
- Check valve: ACETAL with 302 SS spring and nitrile rubber seats
- Pump housing (volute):..... Cast iron
- O-ring and gaskets: EPDM
- Impeller: PES composite (30% glass-filled)
- Terminal box: Noryl® with EPDM gasket
- Flow Range: 0-53 US gpm (0-12 m³/h)
- Head Range:..... 0-46 ft (0-14 m)
- Motors:..... 2-pole, single-phase
- Max. Liquid Temperature: 230°F (110°C)
- Min. Liquid Temperature: 36°F (2°C)
- Max. System Pressure:..... 145 psi (10 bar)

3	115	3.5	370	1/6	40 μF/180V
2		3.1	335	1/6	
1		2.5	265	1/6	

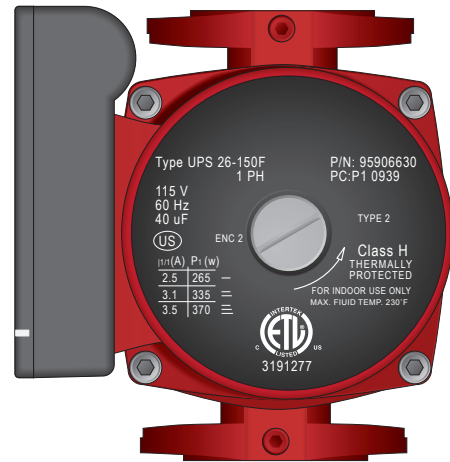


UPS 26-150 Pump Curve

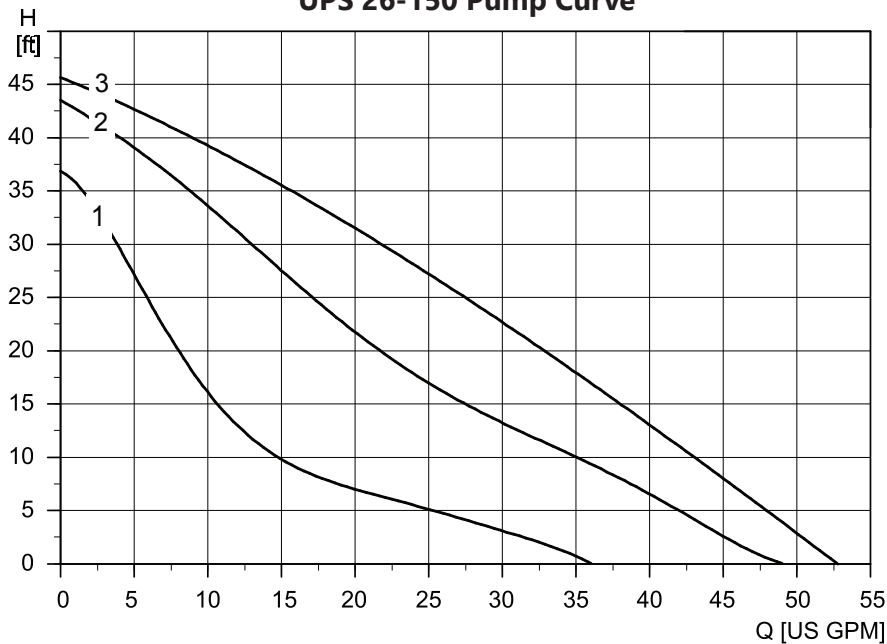



Control Valve

4-way brass mixing valve regulates the temperature in the hydronic system with the help of the electric motor actuator and system controller.

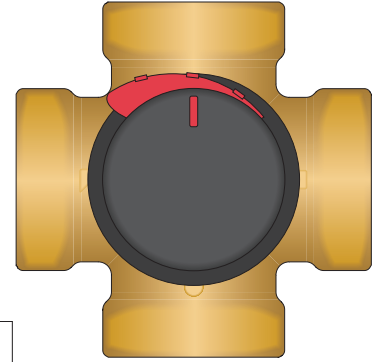

Technical Data - 4-way mixing valve

Material - Valve Body & Slide:	Brass DZR
Material - Shaft & Bushing:.....	PPS composite
Material - O-ring:.....	EPDM
Max. Operating Temperature:.....	230°F (110°C)
Min. Operating Temperature:.....	-15°F (-10°C)
Max. Operating Pressure:.....	145 psi (10 bar)
Max. Differential Pressure:	14.5 psi (1 bar)
Leaking in % of flow*:	<1.0%
Max. Torque:.....	<44lbf*in (<5Nm)

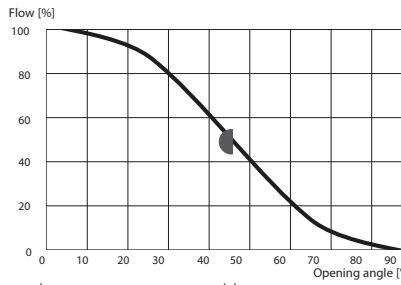

*based on diff. pressure of 14.5 psi (1 bar)

Mixing Valve Motor

The mixing valve motor is mounted to the control valve and moves the valve appropriately to allow the heated fluid to enter. This motor works in conjunction with the system controller.

Manual Operation of Mixing Valve Motor

NOTE: Mixing Valve Motor should not be placed in manual mode for an extended period of time.


- Pull knob out on motorized actuator.
- Rotate knob clockwise or counter-clockwise.
- To return to automatic mode, push the knob in.



The motor should be preceded by a multi-pole contact breaker in the fixed installation.

Technical Data - 3 Point Floating Mixing Valve Motor

Ambient Temperature:	max. 131°F (55°C)
	min. 23°F (-5°C)
Power Supply:.....	24 ± 10% VAC 50 Hz
	230 ± 10% VAC 50 Hz
Enclosure Rating:.....	IP41
Protection Class:.....	II
Torque:.....	6 Nm
Power Consumption - Dimensioning:.....	24V: 3 VA
	230V: 5 VA
Rating Auxiliary Switch:	6(3)A 250VAC
Running Time 90°:	45/120 sec

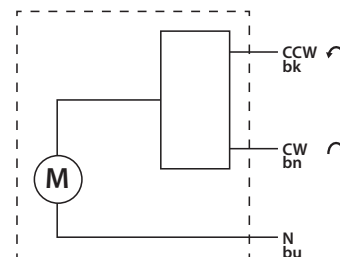


CE LVD 2006/95/EC
EMC 2004/108/EC
RoHS 2011/65/EC

Panel Mounting

Prior to mounting the panel, ensure the wall is capable of supporting the weight of the panel, and that all required power outlets and/or wiring is available at the installation location.



- Step 1** Determine the location and distance between the wall studs. With a level at a minimum height of 4' from the floor, draw a straight line and mark the stud locations. If the panel cannot be secured directly to the studs, or suitable backing boards, plywood may need to be installed behind the panel to properly secure it in place.
- Step 2** Screw two of the supplied mounting screws into the wall studs (or backing plywood) 3/4" and 6 1/2" from the top of the desired height, and 16" apart, leaving 1/4" of the screw out from the wall.
- Step 3** Lift and place the panel onto the mounting screws. Two person lift may be required.
- Step 4** Screw the remaining mounting screws into the holes at the bottom of the panel, and tighten the top two screws.

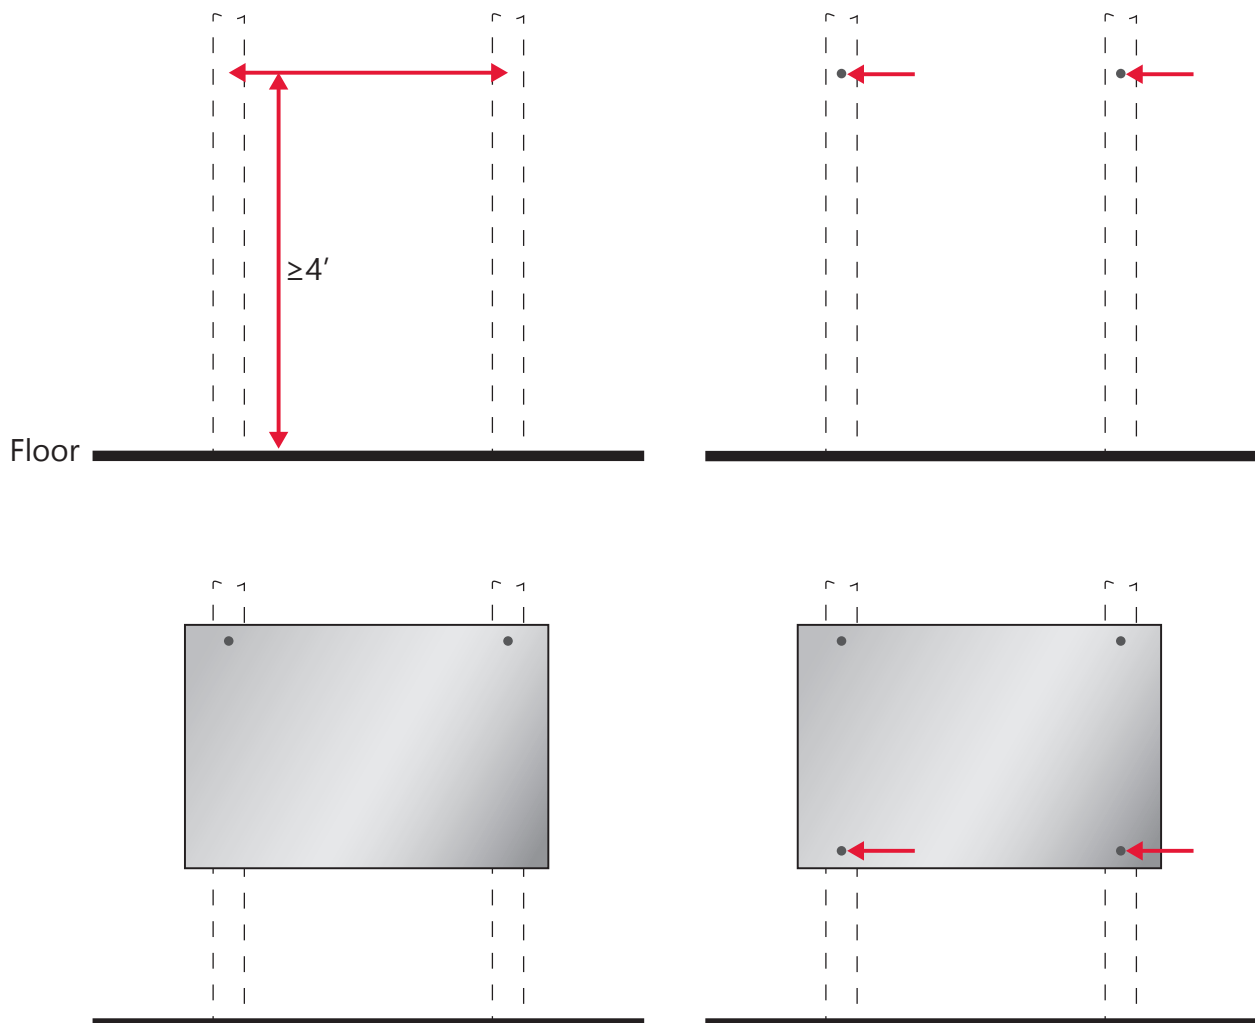

Piping Hookup

The 4WMIX ships with the adapter assemblies packaged in the accessory pack, and must be connected to the panel *after* the system connections have been made.


- Step 1** Piping connections are 1-1/2" MNPT. Use appropriate thread sealant and backup wrench when making connections.
- Step 2** Connect adapter assemblies to the panel. The supplied washers must be used, and nuts must not be overtightened as this may damage the washers.

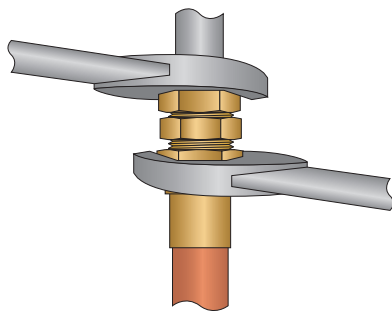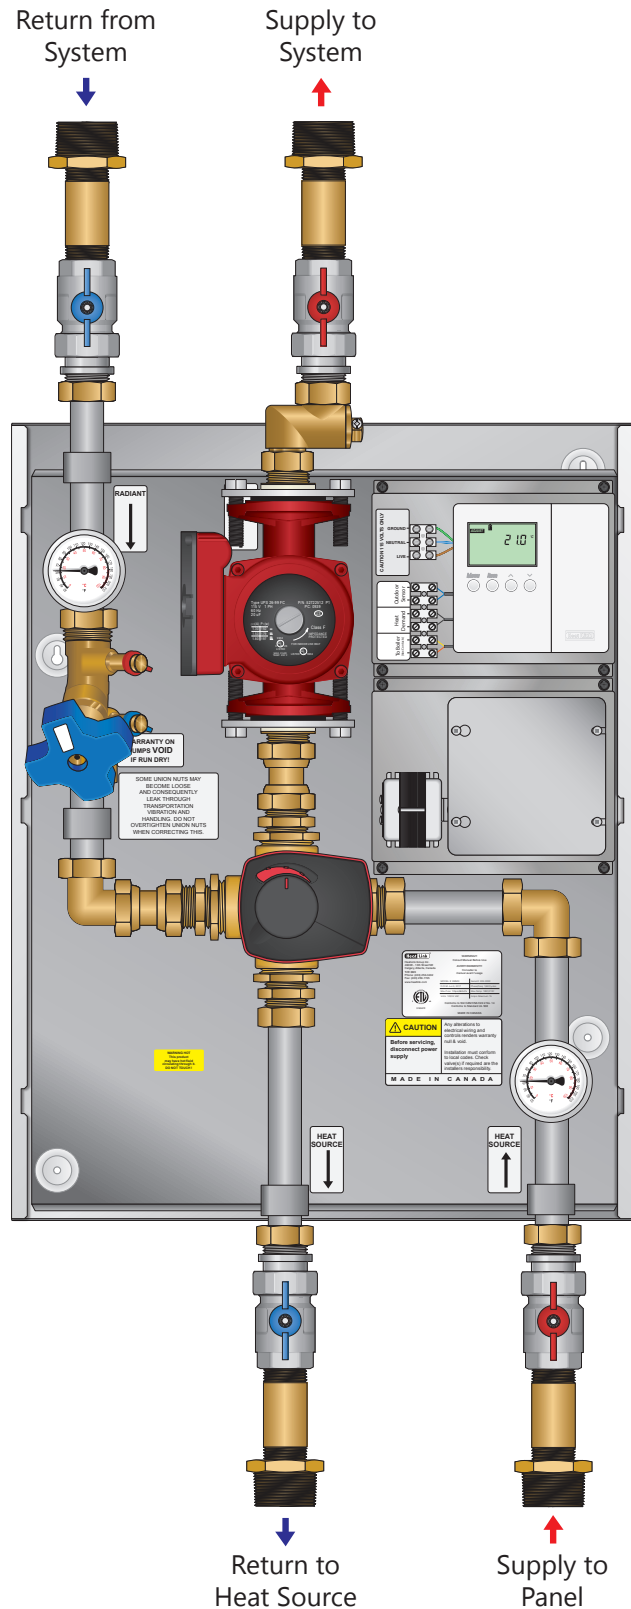

*Always use a Backup Wrench
Do not overtighten brass nuts!*

Fill & Purge

- Step 1 Ensure the panel is not plugged in.
- Step 2 Fully open the mixing valve (fig. B)
- Step 3 Close all isolation ball valves, and attach the fill and purge hoses (not included) to the system fill and purge valves. Open valves.
- Step 4 Open isolation valves and allow water to run until it is free of bubbles.
- Step 5 Close system fill and purge valves.
- Step 6 Detach fill and purge hoses.
- Step 7 Check for leaks at connections. If any leaks are found, use a back-up wrench and carefully tighten until the leak stops. **Do not overtighten!**

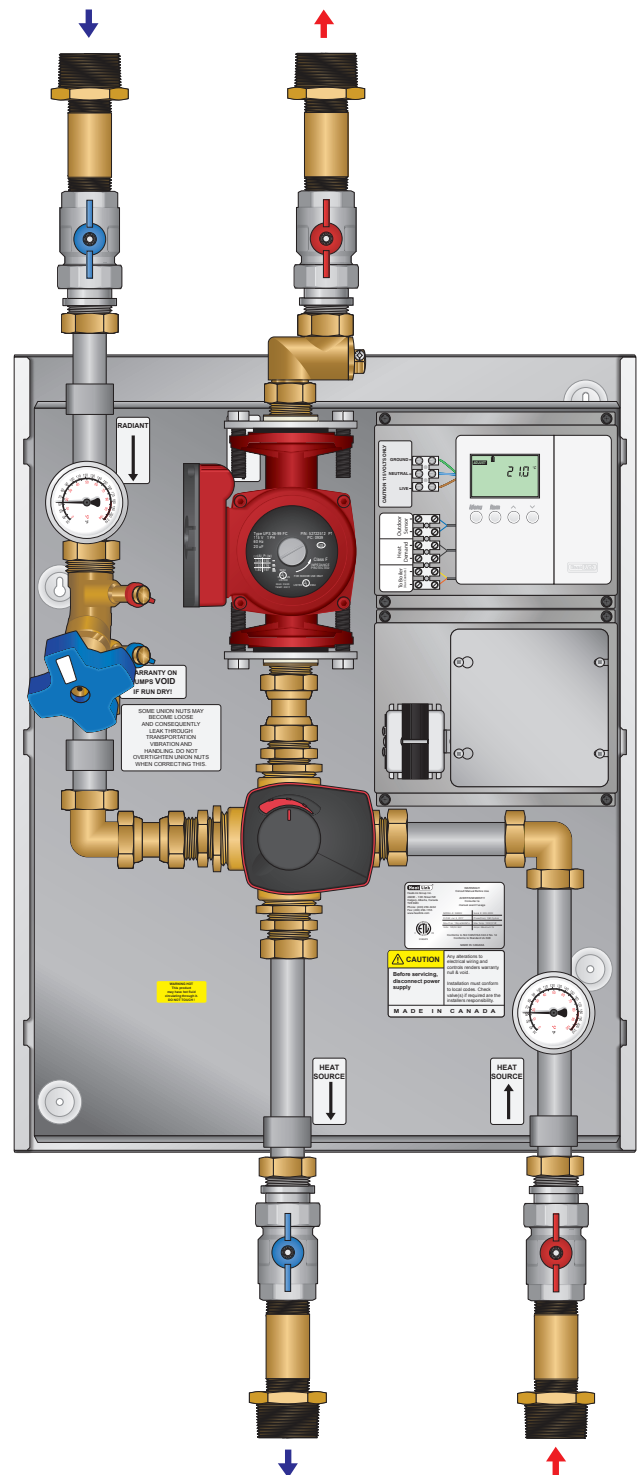

Piping Options



Option #1: Parallel Primary/Secondary

Pros:

- Supply water temperature the same for each load
- No possible pump interference

Cons:

- Requires additional balancing valves for each load take off.
- Hot water migration/gravity flow possible in return riser. Flow check, Spring loaded check valve or thermal trap required in return riser.
- Critical on site installation (Tee spacing and pipe sizing)
- Complex piping

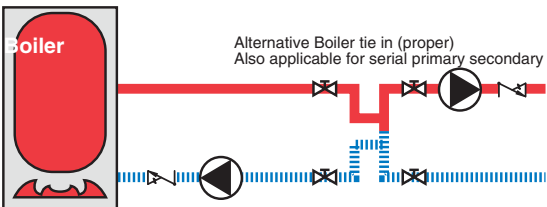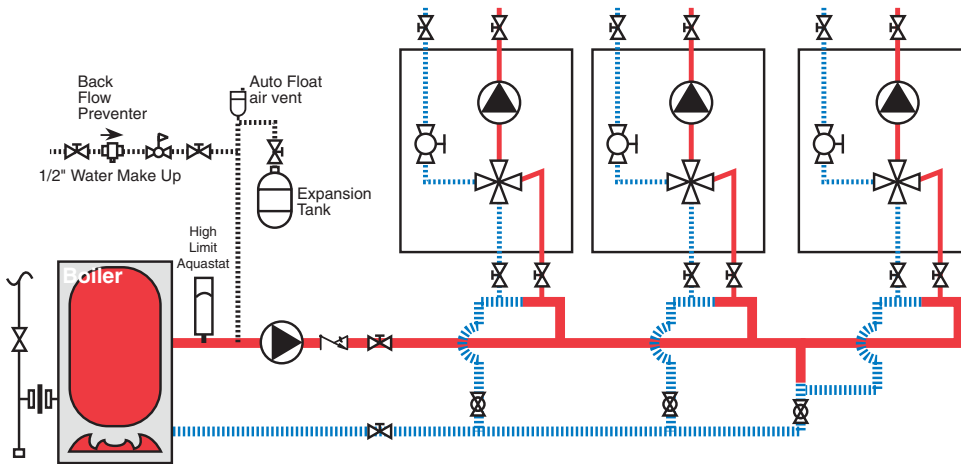

Proper Primary/Secondary piping (shown as alternative boiler tie in), requires an additional pump and triple (rather than the much more common double) pole relays (see page 22).


Option #2: Series Primary/Secondary

Pros:

- Automatic priority
- No possible pump interference

Cons:

- Supply water temperature lowers for each load, this change of temperature is not constant. Some loads may not function if temperature is too low.
- Very expensive to alter priority sequence (note: all loads are prioritized)
- Hot water migration/gravity flow possible in return line. Flow check, Spring loaded check valve or thermal trap required in return riser.
- Critical on site installation (Tee spacing and pipe sizing)

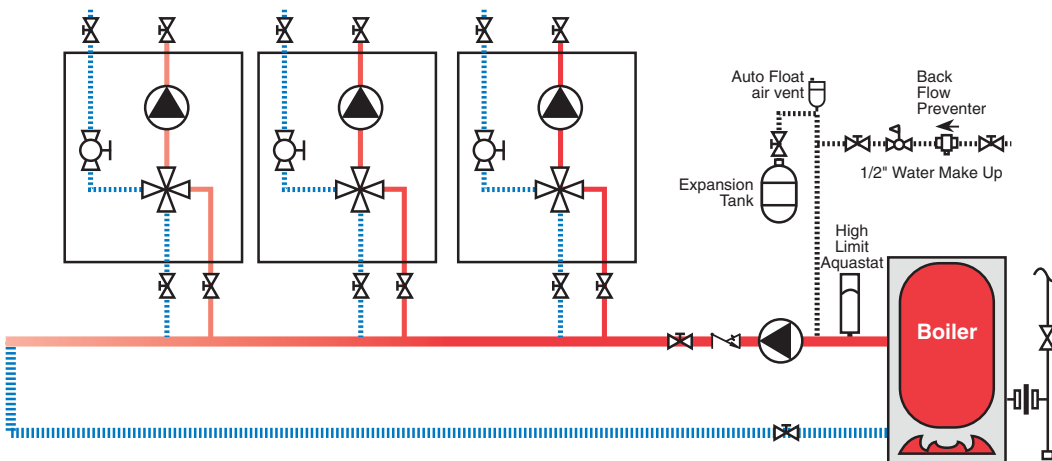


Panel Wiring




- Wiring should be done by a qualified electrician and should meet local codes and jurisdictions.

Auxiliary Contacts The auxiliary contact set is dry, meaning no supply of power is present at the terminal. The maximum allowable load is 1.5A. The auxiliary dry contact located on the terminal is to switch another device (ie. the heat source) when there is a call for heat from any zone.

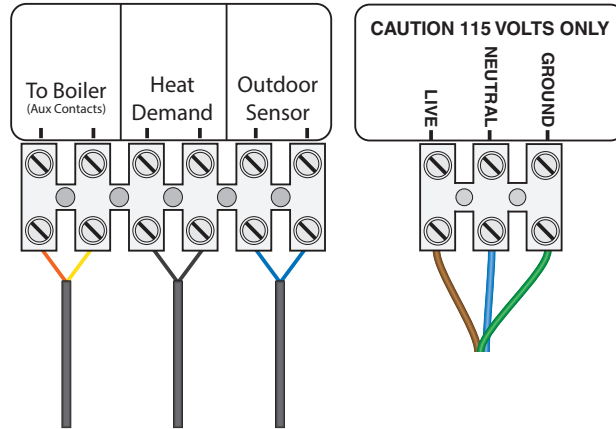


Wiring Diagram

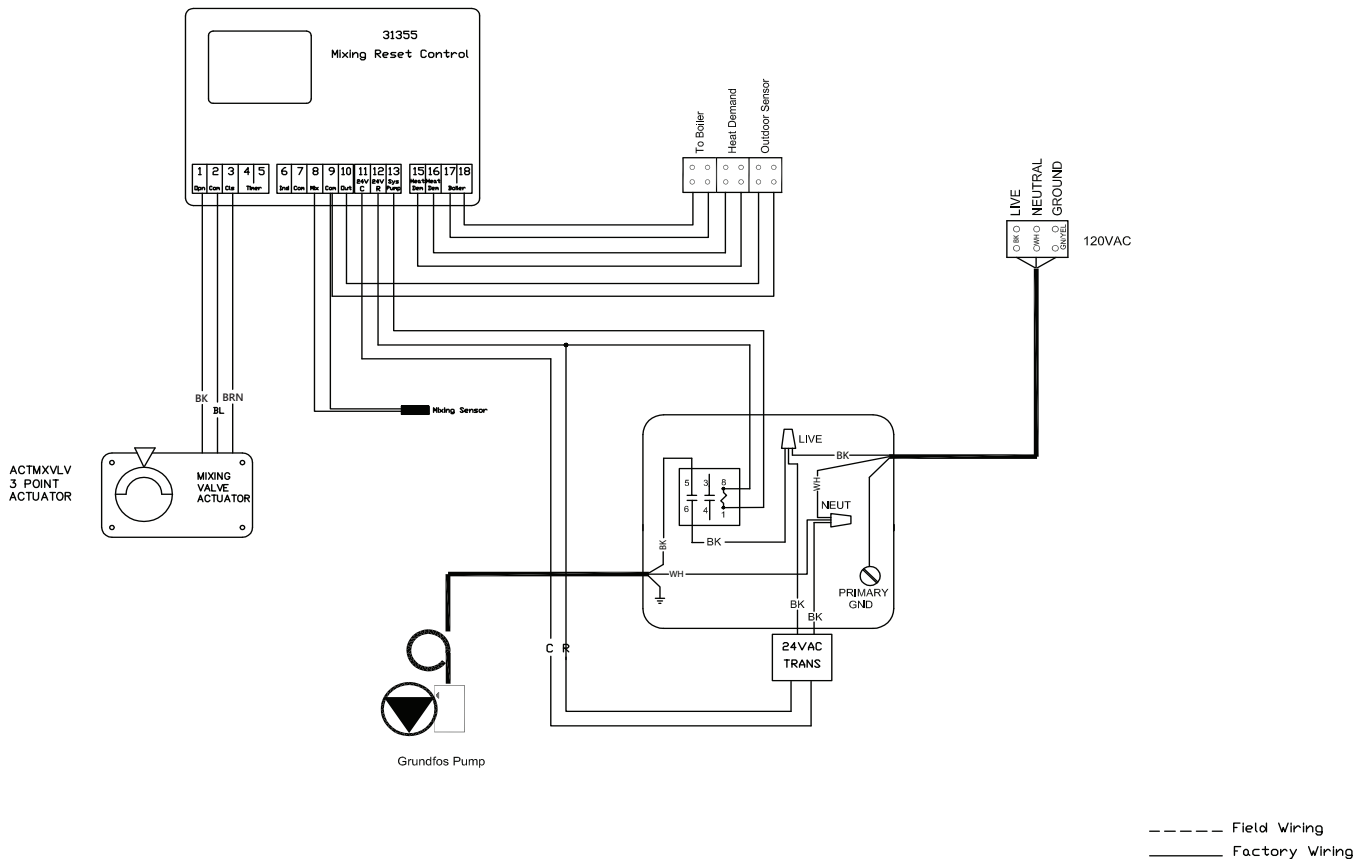

Panel Control Sequence

- Step 1** When the thermostat sends a demand for heat, the reset control ① closes the boiler contacts, turning on the boiler.
- Step 2** The pump ② is then activated, and circulates the system water.
- Step 3** The mixing valve motor ③ will open or close the mixing valve ④ to adjust the supply water temperature.
- Step 4** Once the heat demand has been satisfied, the heat demand contact open, the boiler contacts open and the boiler turns off, and the pump turns off.

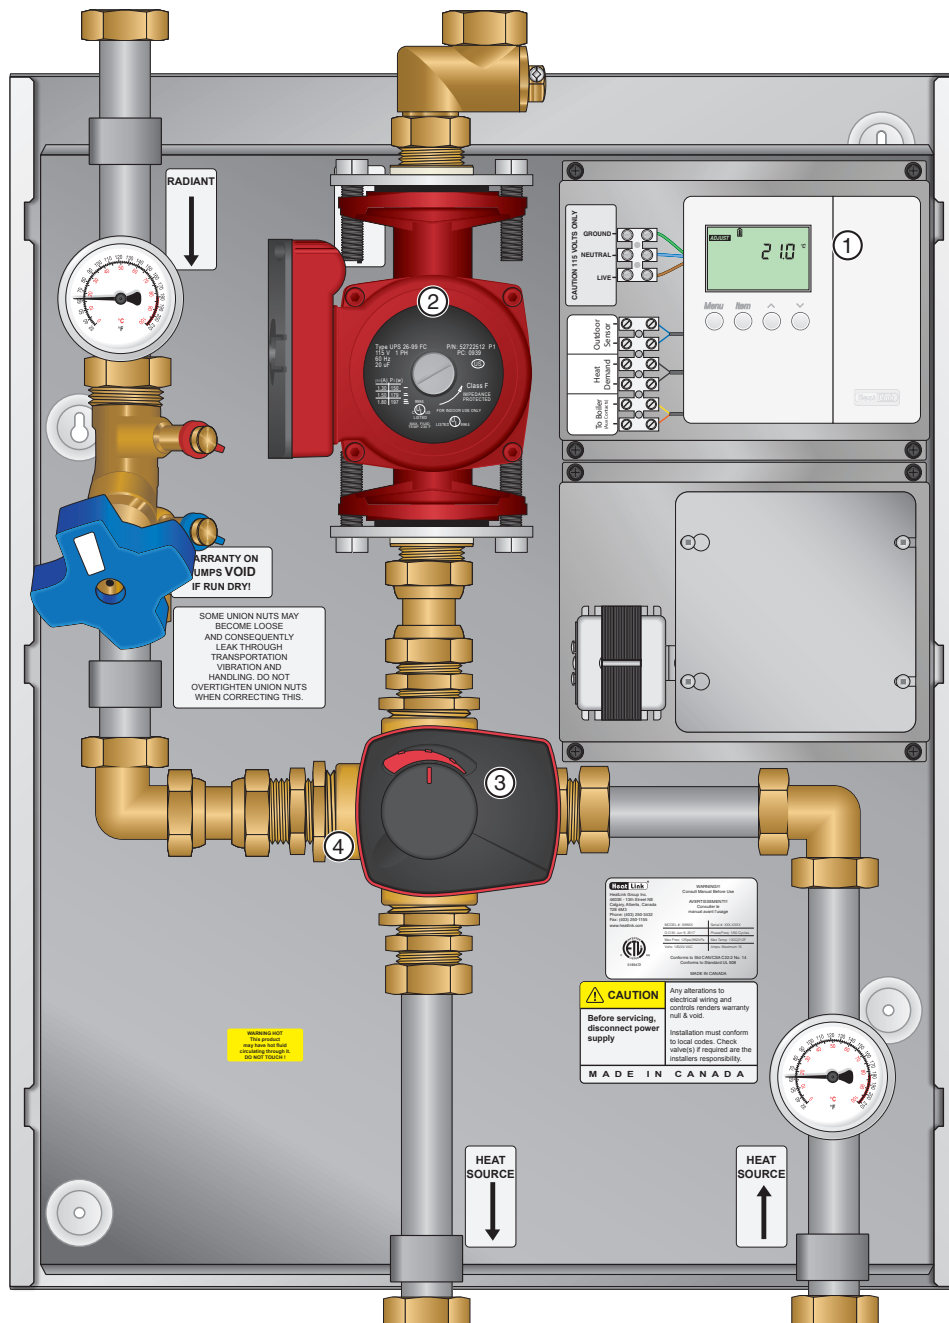

Mixing Reset Control

Technical Data

Mixing Control 31355:	
Packaged weight	600 g (1.3 lbs)
Enclosure	White PVC plastic
Dimensions	4-1/2" H x 4-11/16" W x 15/16" D (114 mm x 119 mm x 24 mm)
Ambient conditions	Indoor use only, 32 to 122°F (0 to 50°C), <90% RH non-condensing
Power	24 V (ac) ± 10% 50/60 Hz, 50 VA (max), 4.5 VA standby
Floating output	24 V (ac) 48 VA (max)
0/2 -10 V (dc) output	2 kΩ minimum load (5 mA maximum current)
Boiler relay	230 V (ac) 5 A
Timer / Pump / Mixing relays	24 V (ac) 2 A
Pump Output	24 V (ac) 48 VA (max) powered output
Mixing demand	Low voltage dry contact
Sensors	NTC thermistor, 10 kΩ @ 77°F (25°C ± 0.2°C) β = 3892
– included	Universal Sensor 30071 and Outdoor Sensor 30070
– optional	Indoor Sensor 30076, 30077

The 31355 control has been approved to the following standards:


- CSA C22.2 No 24-93 Temperature Indicating & Regulating Equipment
- UL 873 Eleventh Edition Temperature Indicating & Regulating Equipment
- Control has been tested to meet CE requirements.

Description

The Compact Mixing Reset Control 31355 regulates the supply water temperature of an automated mixing valve in order to provide outdoor reset or setpoint operation. The 31355 provides a floating action or a 0/2 – 10 V (dc) signal to adjust the mixing valve position. The 31355 also includes two separate night setback channels.

Features

- Outdoor reset for energy savings
- Setpoint
- Floating action
- 0 - 10V (dc)
- 2 - 10 V (dc)
- Two night setback channels

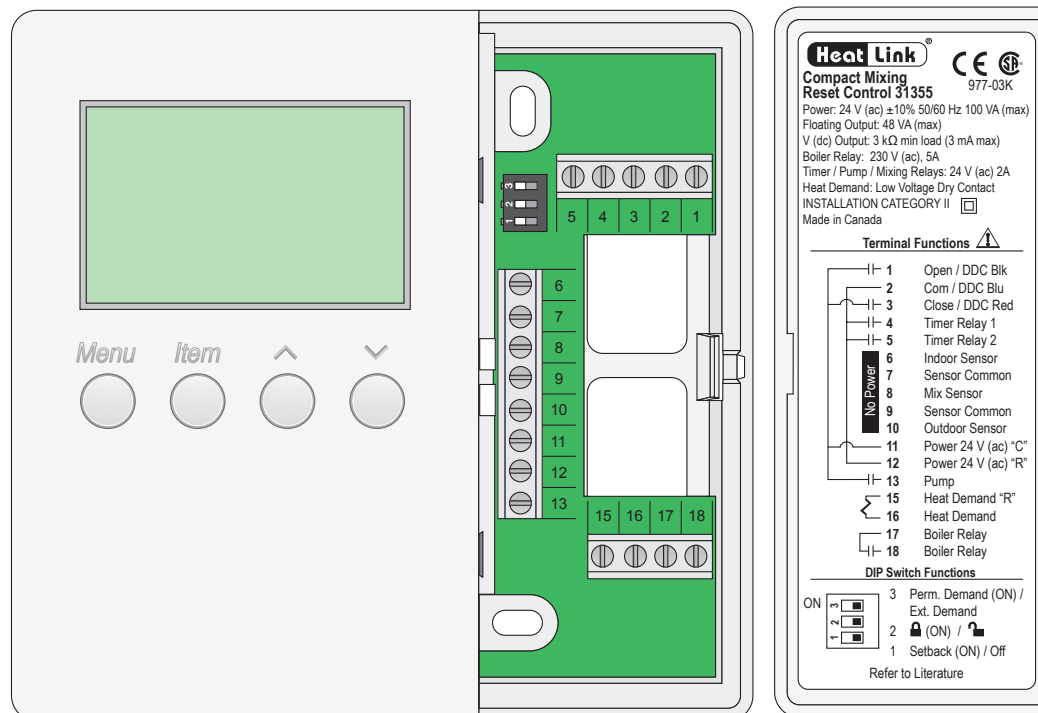

For a full color version of this document, download the PDF from the professional section of our website.

Dip Switches

DIP Switch 3: Permanent / External Demand


- Select whether the control should operate on a permanent demand or on an external demand.

DIP Switch 2: Locked / Unlocked

- Select to lock or unlock the access level. Select 'Lock' to prevent tampering.

DIP Switch 1: Setback / Off

- Select whether or not night setback is desired.

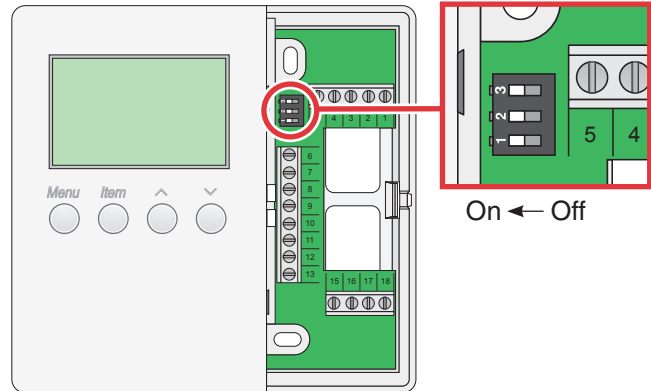

Access Levels


The control has 3 different access levels that restrict the number of viewable items.

- 1) **Ad** = Advanced: This is the highest access level. This level provides access to all settings on the control.
- 2) **InS** = Installer: This is the default access level. This level is suitable for the installer and for troubleshooting.
- 3) **USER** = User: This is the lowest access level. This level is suitable for the building occupants.

Set the Locked /Unlocked DIP switch to the Locked position to allow the access level to be hidden from view. The Locked position prevents unauthorized tampering with the access level.

The Access level for each item is shown in the View, Adjust, Time, Schedule 1 and Schedule 2 menu tables.

Display

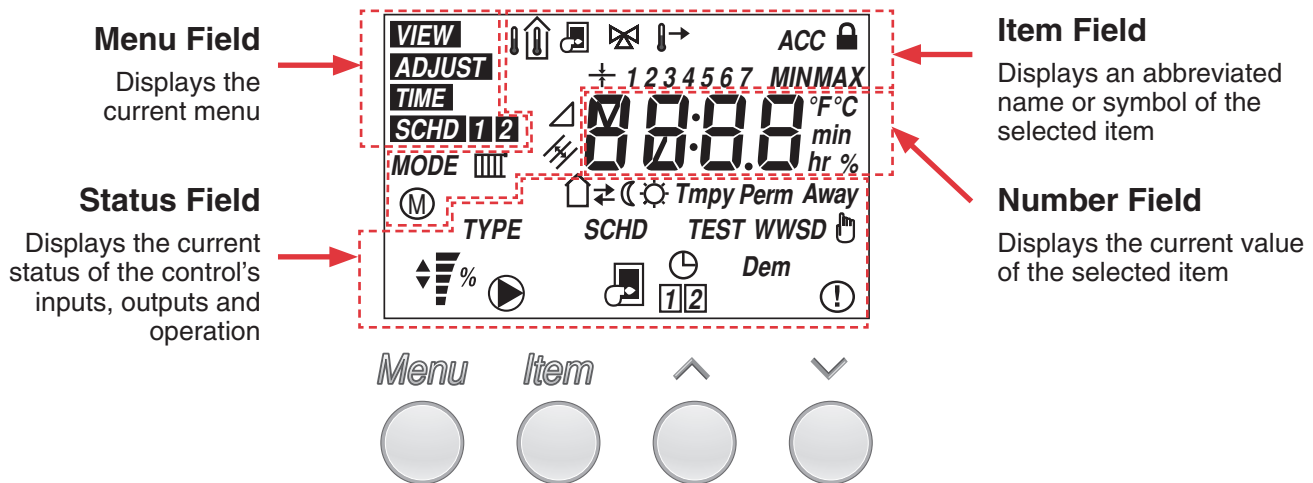

Symbol Description

ACC	ACCESS LEVEL Shown when adjusting the access level.		MOTOR Shown when adjusting motor speed.
Dem	DEMAND Shown when a permanent demand or an external demand is present.		MANUAL OVERRIDE A temporary or permanent override has been manually selected.
	BOILER Shown when the control requires the boiler burner to fire.	TMPY	TEMPORARY A temporary override has been manually selected.
	PUMP Shown when the control turns on the pump. Flashes during the pump purge.	PERM	PERMANENT A permanent override has been manually selected.
	LOCK / UNLOCK A padlock is shown when the access level is locked.		WAKE Wake time period event.
	WARNING Shown when an error message is present on the control.		UNOCCUPIED Unoccupied time period event.
	MIXING VALVE OUTPUT SCALE The mixing valve position represented as a bar graph. Arrows show whether the valve is opening or closing.		OCCUPIED Occupied time period event.
	TERMINAL UNIT The type of space heating units. Select one of 6 different types.		SLEEP Sleep time period event.
	OUTDOOR TEMPERATURE Shown together with the current measured outdoor temperature.	Away	AWAY The away override has been manually selected.
	INDOOR TEMPERATURE Shown together with the current measured indoor temperature.	WWSD	WWSD The outdoor temperature above which the heating is shut off.
	TARGET Shown together with another symbol to indicate target temperature. Example shown: Indoor Target Temperature.		TIMER 1 Shown when timer 1 schedule is in night setback.
	DESIGN Shown together with another symbol to indicate design temperature. Example shown: Outdoor Design Temperature.		TIMER 2 Shown when the timer 2 schedule is in night setback.
	MIX Shown together with another symbol to indicate mixing parameters.	DAYS OF THE WEEK 1 = Monday 2 = Tuesday 3 = Wednesday 4 = Thursday 5 = Friday 6 = Saturday 7 = Sunday	
	SUPPLY TEMPERATURE Shown together with another symbol to indicate supply temperature. Example shown: Mix Supply Temperature.		
	ROOM Shown when adjusting room temperature.		

User Interface

The 31355 has four buttons: Menu, Item, Up, Down.

Menu Button    

Each press and release of the Menu button advances the display to the next menu.

Five menus are available:


- VIEW
- ADJUST
- TIME
- SCHD 1 (Schedule 1)
- SCHD 2 (Schedule 2)

Item Button    

Each press and release of the Item button advances the display to the next item in the same menu.


Up or Down Button    

Each press and release of the up or down button changes the number value while in the 'ADJUST, TIME, SCHD 1, or SCHD 2' menus.

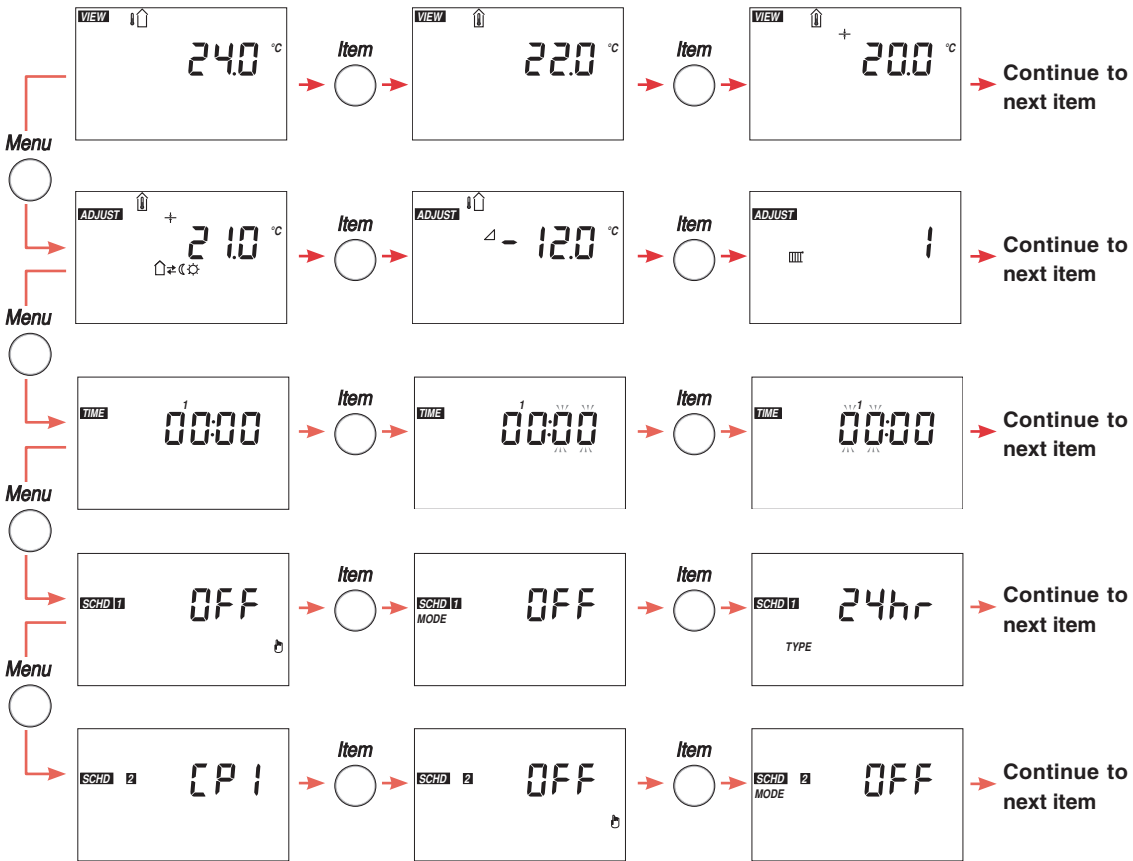





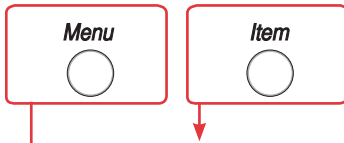





























Setup

All settings are stored in permanent memory which is not affected by power loss.



The View menu items display the current operating temperatures and status information of the system.

VIEW MENU


Item Field	Range	Access	Description
 	-60 to 65°C (-76 to 149°F)	Ad InS USER	 OUTDOOR <ul style="list-style-type: none"> The measured outdoor temperature. Only available when outdoor design is not set to off.
 	-30 to 130°C (-22 to 266°F)	Ad InS USER	 INDOOR <ul style="list-style-type: none"> The measured indoor air temperature. Only available when outdoor design is not set to off and when an indoor air sensor is used.
 	---, -30 to 130 °C (---, -22 to 266°F)	Ad InS USER	 INDOOR TARGET <ul style="list-style-type: none"> The desired indoor air temperature. Only available when outdoor design is not set to off and when an indoor air sensor is used.
 	-30 to 130°C (-22 to 266°F)	Ad InS USER	 MIX SUPPLY <ul style="list-style-type: none"> The measured mix supply temperature. Not available in the User access level when an indoor air sensor is used.
 	---, -30 to 130 °C (---, -22 to 266°F)	Ad InS	 MIX TARGET <ul style="list-style-type: none"> The temperature target the control is to maintain at the mixing valve outlet.
  	Wake  , Unocc  , Occ  , Sleep  , <i>TMPY</i> , <i>PERM</i> , <i>Away</i> , Override 	Ad InS USER	Schd SCHEDULE 1 <ul style="list-style-type: none"> Schedule 1 operational status. Only available when DIP switch 3 is set to External Demand.
  	Wake  , Unocc  , Occ  , Sleep  , <i>TMPY</i> , <i>PERM</i> , <i>Away</i> , Override 	Ad InS USER	Schd SCHEDULE 2 <ul style="list-style-type: none"> Schedule 2 operational status. Only available when DIP switch 3 is set to External Demand and the Schedule Mode is not set to OFF.
  	J11 alternating with 74A	Ad InS	TYPE TYPE <ul style="list-style-type: none"> The software version (J11 74 is constant).

After the last item, the control returns to the first item in the menu.

Menu



Item



The Adjust Menu items are the programmable settings used to operate the mechanical equipment.

ADJUST MENU

Item Field	Range	Access	Description
	4.5 to 35.0°C (40 to 95°F)	Ad InS USER	INDOOR TARGET <ul style="list-style-type: none"> Enter the desired indoor air temperature with indoor temperature feedback. The control adjusts water temperature to maintain desired indoor air temperature. Only available when an indoor sensor is connected, and outdoor design is not set to off and dip switch 3 is set to permanent demand. For 2 event schedules: ☀, ☾. For 4 event schedules: ☀, ☷→, ☷←, ☾.
☀ <i>Wake</i>	Default = 21.0°C (70°F)		
☷→ <i>UnOccupied</i>	Default = 16.5°C (62°F)		
☷← <i>Occupied</i>	Default = 21.0°C (70°F)		
☾ <i>Sleep</i>	Default = 16.5°C (62°F)		
	4.5 to 35.0°C (40 to 95°F) Default = 21.0°C (70°F)	Ad InS	ROOM <ul style="list-style-type: none"> Increases or decreases the heat to the room when not using indoor temperature feedback. Room setting fine tunes the mix supply water temperature. Only available when there is no indoor sensor connected, and outdoor design is not set to off.
	-51.0 to 7.0°C, OFF (-60 to 45°F, OFF) Default = -12.0°C (10°F)	Ad InS	OUT DESIGN <ul style="list-style-type: none"> Enter the coldest annual outdoor temperature of your area. Setting outdoor design to off disables outdoor reset and enables setpoint operation.
	1, 2, 3, 4, 5, 6	Ad InS	TERMINAL <ul style="list-style-type: none"> Enter the type of heating terminal units installed. 1 = Underfloor Heating (Wet) 2 = Underfloor Heating (Dry) 3 = Fan coil 4 = Fin tube convector 5 = Radiator 6 = Baseboard Only available when outdoor design is not set to off.
	4.5 to 35.0°C (40 to 95°F) Default = 21.0°C (70°F)	Ad	MIX INDOOR <ul style="list-style-type: none"> The outdoor reset characterized heating curve starting point. Only available when outdoor design is not set to off.
	21.0 to 104.5°C (70 to 220°F) Default = 49.0°C (120°F)	Ad	MIX DESIGN <ul style="list-style-type: none"> The water temperature required for heating on the coldest annual temperature of your area. Only available when outdoor design is not set to off.
	OFF, 1.5 to 65.5°C (OFF, 35 to 150°F) Default = OFF	Ad	MIX MINIMUM <ul style="list-style-type: none"> The minimum mix target outlet temperature. Only available when outdoor design is not set to off.

Continued on next page.

ADJUST MENU

Item Field	Range	Access	Description
 	27.0 to 107.0°C (80 to 225°F) Default = 60.0°C (140°F)	Ad	MIX MAXIMUM <ul style="list-style-type: none"> The maximum mix target outlet temperature. Only available when outdoor design is not set to off.
 	4.5 to 38.0°C, OFF (40 to 100°F, OFF) Default = 22.0°C (72°F)	Ad InS	WARM WEATHER SHUT DOWN <ul style="list-style-type: none"> The outdoor temperature above which the heating is shut off. Only available when outdoor design is not set to off.
 Wake Occ	Default = 22.0°C (72°F)		
 Sleep UnOcc	Default = 15.5°C (60°F)		
 	15.5 to 93.5°C (60 to 200°F) Default = 38.0°C (100°F)	Ad InS	MIX TARGET <ul style="list-style-type: none"> Setpoint mix target temperature. Only available when outdoor design is set to off.
 	0:10, 2:10, Flot Default = Flot	Ad	MIX MODE <ul style="list-style-type: none"> The control can provide 3 different output signals to a mixing valve actuator: 0:10 = 0 to 10 V (dc) analogue signal 2:10 = 2 to 10 V (dc) analogue signal Flot = 24 V (ac) floating action
 	30 to 230 seconds Default = 150 seconds	Ad	MOTOR SPEED <ul style="list-style-type: none"> The time to operate the mixing valve from fully closed to fully open. The default value of 150s is the proper setting for the HeatLink® 56121 DDC actuator and 58100 series mixing valve motors.
 	OFF, 0:05 to 10:00 Default = 0:20	Ad	PUMP <ul style="list-style-type: none"> mm:ss System pump purge time once the heat demand is removed. Use of this feature without a bypass or continuous flow loops can result in dead heading of the pump.
 	10 to 70% (5% increments) Default = 25%	Ad	BOILER ON <ul style="list-style-type: none"> Boiler on trigger point as the mixing valve opens.
 	0 to 50% (5% increments) Default = 5%	Ad	BOILER OFF <ul style="list-style-type: none"> Boiler off trigger point as the mixing valve closes.
 	USEr, InS, Ad Default = InS	Ad InS	ACCESS LEVEL <ul style="list-style-type: none"> The control has 3 access levels: Ad = Advanced: All settings are available. InS = Installer: The factory default access level allows basic setting changes. USEr = User: Access level for building occupants. <ul style="list-style-type: none"> The access level hides certain settings from the View, Adjust, Schedule 1 and Schedule 2 menus.

Continued on next page.


Adjust Menu (3 of 3)

ADJUST MENU

Item Field	Range	Access	Description
	OFF, FLd, MAn Default = OFF	Ad InS	TEST <ul style="list-style-type: none"> Select the field test (FLd) or Maximum Heat (MAn) feature.
	°F, °C Default = °C	Ad InS USER	°F °C TEMPERATURE UNITS <ul style="list-style-type: none"> Select either Celsius or Fahrenheit temperature units to display temperature.

• After the last item, the control returns to the first item in the menu.

Time Menu (1 of 1)




The Time menu items set the time clock and day.

TIME MENU

Item Field	Range	Access	Description
		Ad InS USER	CURRENT TIME AND DAY <ul style="list-style-type: none"> Displays the current time and day. Only available when the Setback DIP switch is set to on.
	00 to 59	Ad InS USER	CLOCK MINUTES <ul style="list-style-type: none"> Set the minutes. Only available when the Setback DIP switch is set to on.
	00 to 23	Ad InS USER	CLOCK HOURS <ul style="list-style-type: none"> Set the hours. Only available when the Setback DIP switch is set to on.
	1 = Monday 2 = Tuesday 3 = Wednesday 4 = Thursday 5 = Friday 6 = Saturday 7 = Sunday Default = Monday	Ad InS USER	DAY OF THE WEEK <ul style="list-style-type: none"> Set the day of the week. Only available when the Setback DIP switch is set to on.

• After the last item, the control returns to the first item in the menu.

Schedule 1 Menu (1 of 1)

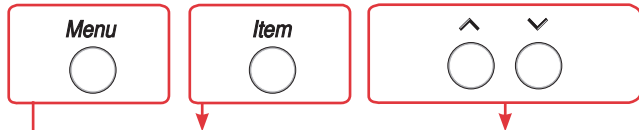


The Schedule menu items set the schedule type, the number of events per day, and the event times.

SCHD 1 MENU

Item Field	Range	Access	Description
	OFF, <i>TMPLY</i> ✱, <i>PERM</i> ✱, <i>TMPLY</i> ⬆️, <i>PERM</i> ⬆️, <i>TMPLY</i> ⬇️, <i>PERM</i> ⬇️, <i>TMPLY</i> Ⓞ, <i>PERM</i> Ⓞ, <i>Away</i> Default = OFF	Ad InS USER	MANUAL OVERRIDE <ul style="list-style-type: none"> Select a manual override for schedule 1. Ignores the regular schedule. Temporary manual override lasts 3 hours. Permanent and Away manual override remains until manually changed.
	OFF, 2, 4 Default = OFF	Ad InS	MODE <ul style="list-style-type: none"> Select the number of setback events per day for schedule 1. Only available when the Setback DIP switch is set to on.
	24 hr, 5-11, 7dAY Default = 24hr	Ad InS	TYPE <ul style="list-style-type: none"> Select the type of repeating schedule for schedule 1. Only available when the Setback DIP switch is set to on.
When a 5-11 or a 7 day schedule is selected, each day or group of days require individual event settings.			
	--:-- to 23:50 PM Default = 06:00	Ad InS USER	DAY 1 TO DAY 7 ✱ WAKE <ul style="list-style-type: none"> Select the starting time for the Wake event for schedule 1. Only available when the Setback DIP switch is set to on.
	--:-- to 23:50 PM Default = 08:00	Ad InS USER	DAY 1 TO DAY 7 ⬆️ UNOCCUPIED <ul style="list-style-type: none"> Select the starting time for the Unoccupied event for schedule 1. Only available when the Setback DIP switch is set to on.
	--:-- to 23:50 PM Default = 16:00	Ad InS USER	DAY 1 TO DAY 7 ⬆️ OCCUPIED <ul style="list-style-type: none"> Select the starting time for the Occupied event for schedule 1. Only available when the Setback DIP switch is set to on.
	--:-- to 23:50 PM Default = 22:00	Ad InS USER	DAY 1 TO DAY 7 Ⓞ SLEEP <ul style="list-style-type: none"> Select the starting time for the Sleep event for schedule 1. Only available when the Setback DIP switch is set to on.

After the last item, the control returns to the first item in the menu.

Schedule 2 Menu (1 of 2)



The Schedule menu items set the schedule type, the number of events per day, and the event times.



SCHD 2 MENU

Item Field	Range	Access	Description
	CP1, On, OFF Default = CP1	Ad InS USEr	Schd SCHD <ul style="list-style-type: none"> Select whether night setback 2 is operational. CP1 (Copy 1) = Night setback schedule 2 copies the event times of schedule 1. On = Night setback schedule 2 operates on an independent schedule. OFF = Night setback schedule 2 is disabled.
	OFF, <i>TMPY</i> ✖, <i>PERM</i> ✖, <i>TMPY</i> ⬆→, <i>PERM</i> ⬆→, <i>TMPY</i> ⬆←, <i>PERM</i> ⬆←, <i>TMPY</i> ⌚, <i>PERM</i> ⌚, <i>Away</i> Default = OFF	Ad InS USEr	MANUAL OVERRIDE <ul style="list-style-type: none"> Select a manual override for schedule 2. Ignores the regular schedule. Temporary manual override lasts 3 hours. Permanent and Away manual override remains until manually changed.
	OFF, 2, 4 Default = OFF	Ad InS	MODE MODE <ul style="list-style-type: none"> Select the number of setback events per day for schedule 2. Only available when the Setback DIP switch is set to on.
	24 hr, 5-11, 7dAY Default = 24 hr	Ad InS	TYPE TYPE <ul style="list-style-type: none"> Select the type of repeating schedule for schedule 2. Only available when the Setback DIP switch is set to on.
When a 5-11 or a 7 day schedule is selected, each day or group of days require individual event settings.			
	--:-- to 23:50 PM Default = 06:00	Ad InS USEr	DAY 1 TO DAY 7 WAKE <ul style="list-style-type: none"> Select the starting time for the Wake event for schedule 2. Only available when the Setback DIP switch is set to on.
	--:-- to 23:50 PM Default = 08:00	Ad InS USEr	DAY 1 TO DAY 7 UNOCCUPIED <ul style="list-style-type: none"> Select the starting time for the Unoccupied event for schedule 2. Only available when the Setback DIP switch is set to on.
	--:-- to 23:50 PM Default = 16:00	Ad InS USEr	DAY 1 TO DAY 7 OCCUPIED <ul style="list-style-type: none"> Select the starting time for the Occupied event for schedule 1. Only available when the Setback DIP switch is set to on.

Continued on next page.

Schedule 2 Menu (2 of 2)

SCHD 2 MENU

Item Field	Range	Access	Description
	--:-- to 23:50 PM Default = 22:00	Ad InS USEr	DAY 1 TO DAY 7  SLEEP <ul style="list-style-type: none"> • Select the starting time for the Sleep event for schedule 1. • Only available when the Setback DIP switch is set to on.

After the last item, the control returns to the first item in the menu.

Modes of Operation


The 31355 can function in three different modes of operation.

1) Outdoor Reset Multizone Operation

- Indoor temperature feedback from Thermostats by use of the external heat demand input contacts.
- The heat demand is activated whenever a thermostat calls for heat.
- Whenever the control is powered up, a heat demand is present and not in WWSD, the control operates the valve, boiler and pump to maintain an outdoor reset mix target temperature at the mix supply sensor.
- The Room setting allows for manual parallel shifting of the heating curve.
- Two optional night setback schedules operate the Timer 1 and 2 relay contacts.

Required Settings:

- DIP Switch 3 = External Demand
- Indoor Air Sensor is not installed.
- Outdoor Design = Set to the coldest annual temperature in your area.

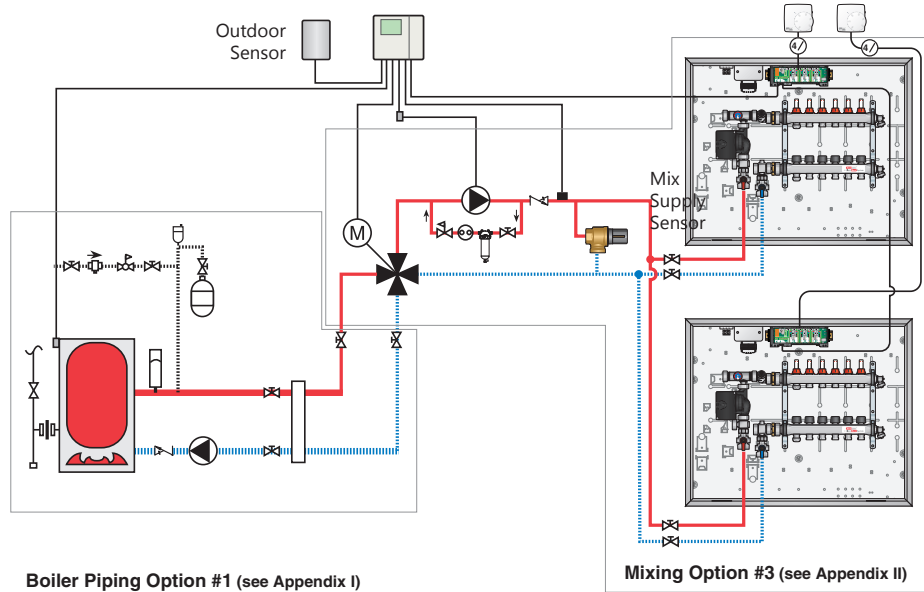


2) Outdoor Reset Single Zone Operation

- Indoor temperature feedback from external indoor air sensor.
- The control operates in permanent heat demand.
- Whenever the control is powered up and not in WWSD, the control operates the valve, boiler and pump to maintain an outdoor reset mix target temperature at the mix supply sensor.
- Indoor temperature sensing allows for automatic parallel shifting of the heating curve.
- Single setback schedule
- Timer relay 1 and 2 operate in parallel.

Required Settings:

- DIP Switch 3 = Permanent Demand
- Indoor Air Sensor is installed.
- Outdoor Design = Set to the coldest annual temperature in your area.

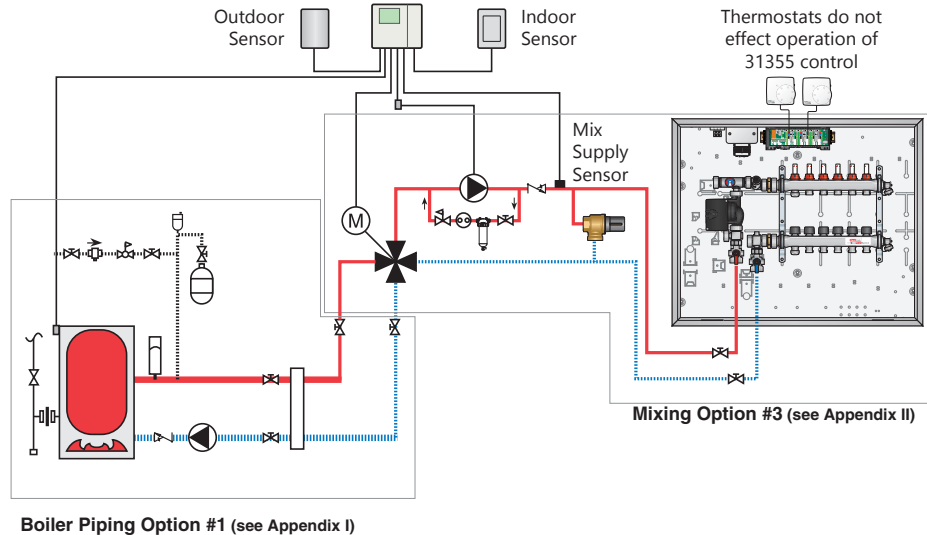

Sequence of Operation

Warm Weather Shut Down

Warm Weather Shut Down (**WWSD**) occurs when the outdoor air temperature is warmer than the WWSD setting ($\pm 1^\circ\text{F}$). If a setback schedule is selected, the control allows for two WWSD settings. If only one schedule is active, WWSD occurs with the appropriate schedule. If two schedules are active, **WWSD** * ← “WWSD Wake Occ” occurs when either one or both of the schedules are in the Wake Sleep events; and **WWSD** → “WWSD Unocc Sleep” occurs when both schedules are in the Unocc Sleep events. Whenever the control is in WWSD, the **WWSD** segment is displayed.

Heat Demand

A heat demand is required in order for operation to occur. A heat demand is present when:

1) **Permanent Demand** – DIP Switch 3 is set to Permanent Demand.

or

2) **External Demand** – (DIP Switch 3 is set to external demand). Whenever a contact closure (short) is applied across the heat demand terminals (13 & 14) The **Dem** icon is turned on whenever a heat demand is present.

Mixing Valve Operation

Whenever the control is powered up, a heat demand is present and not in WWSD, the control provides a mixing output to an actuator which drives a mixing valve to maintain either an outdoor reset mix target temperature or setpoint mix target temperature at the mix supply sensor.

Output Signal MODE

The control can provide 3 different output signals to a mixing valve actuator:


- 1) 0:10 = 0 to 10 V (dc) analogue signal
- 2) 2:10 = 2 to 10 V (dc) analogue signal
- 3) Flot = 24 V (ac) floating action. The control pulses the open or close outputs to actuate the mixing valve.

The 31355 control has a 15 second delay before operating the valve once a heat demand is applied. The 15 second delay is to allow the pump to circulate the water in the system and to stabilize temperatures so that the sensor does not see any temperature spikes.

The time to change from closing the valve to opening the valve is dependent on the Motor Speed and the PID error difference between the mix supply sensor and the mix target. Therefore, there is no fixed time to change from close to open on the valve.

Outdoor Reset Operation

The control adjusts the mix target temperature with changing weather conditions using a characterized heat curve. An outdoor sensor is required. Outdoor reset adjusts the mixing valve supply water temperature to compensate for additional heat loss as the outdoor temperature falls.

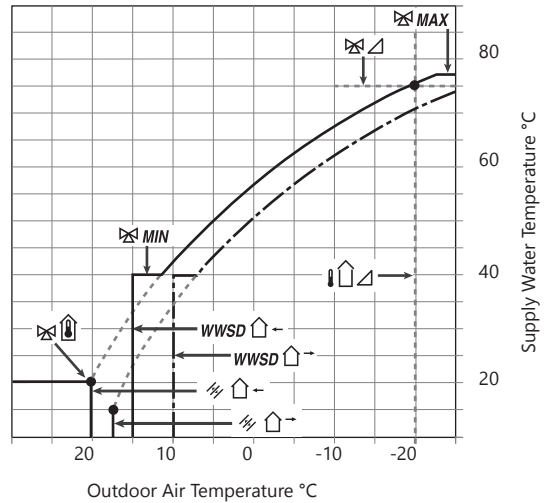

There are 8 required settings for outdoor reset operation:

1) **Indoor or Room**

Indoor Sensor Feedback

- The indoor setting is only available when an indoor air sensor is present.
- Indoor sensor feedback allows the control to compensate for internal indoor heat gains and additional heat losses such as wind loss which outdoor reset does not account for.
- When an indoor sensor and a permanent demand is present, the Timer 1 and Timer 2 contacts are disabled. Instead, there are up to four separate Indoor Target temperature settings.

Room Setting (No Indoor Sensor Feedback)

- When an indoor air sensor is not present, the outdoor reset water temperature can be adjusted using the room setting.
- This provides fine tune adjustment by parallel shifting the entire heating curve.

2) **Outdoor Design** - The Outdoor Design is the coldest annual temperature in the area. If the Outdoor Design is set to OFF, the control operates in the setpoint operation and disables outdoor reset.

3) **Terminal Unit** - There are 6 different terminal units. When a terminal unit is selected, the control automatically changes the mix design, the mix minimum, and the mix maximum default settings. The defaults can be changed to better match the installed system.

4) **Mix Indoor** - The Mix Indoor is the starting point of the characterized heating curve. This is typically set to 21°C (70°F).

5) **Mix Design** - The water temperature required to heat the building on the coldest day of the year.


6) **Mix Minimum** - The lowest mix water target temperature.

7) **Mix Maximum** - The highest mix water target temperature. This can be used to help prevent overheating on a radiant floor.


8) **Warm Weather Shut Down** *WWSD* - When the outdoor temperature exceeds the Warm Weather Shut Down (WWSD) setting, the heating system is shut down by closing the mixing valve.

Terminal Units


Underfloor Heating (Wet) (1)

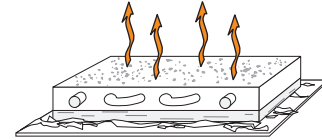


Underfloor Heating (Dry) (2)

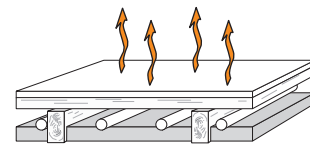


Fancoil (3)

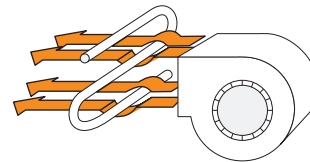


Fin-Tube Convactor (4)



Radiator (5)



Baseboard (6)






Terminal Unit	Mix Design	Mix MAX	Mix MIN
Underfloor Heating (Wet) (1)	49°C (120°F)	60°C (140°F)	OFF
Underfloor Heating (Dry) (2)	60°C (140°F)	71°C (160°F)	OFF
Fancoil (3)	88°C (190°F)	99°C (210°F)	38°C (100°F)
Fin-Tube Convactor (4)	82°C (180°F)	93°C (200°F)	OFF
Radiator (5)	71°C (160°F)	82°C (180°F)	OFF
Baseboard (6)	66°C (150°F)	77°C (170°F)	OFF



Setpoint Operation

The control can operate the mixing valve to maintain a fixed setpoint outlet temperature.

To enter the setpoint mix target temperature:

Press the Menu  button to enter the 'ADJUST' menu.

Press the Item  button to find Outdoor Design  and set to 'OFF'.

Press the Item  button to find Mix Target  and set the mixing valve outlet temperature.

Boiler Output

Output Signal

The control operates the boiler relay as a boiler enable. The "Boiler ON" setting allows the adjustment of the boiler enable point as the mixing valve is opened (default of 25%). The "Boiler OFF" setting allows the adjustment of the boiler shut off point as the mixing valve is closed (default of 5%).

The boiler contact has a 3 minute minimum on time regardless if heat demand is removed. The pump is on while the boiler contact is on. Once the demand is removed, the mixing valve is closed. The minimum off time for the boiler relay is 20 seconds.

Warning:

The boiler minimum on time can cause the dead heading of the pump if no bypass or continuous flow loops are present.

Motor Speed

The control requires the motor speed time to operate the mixing valve from fully closed to fully open. The default value of 150s is the proper setting for the HeatLink[®] 56121 DDC actuator and 58100 series mixing valve motors.


Pump Operation

The control includes a powered boiler pump. When the DIP switch is set to permanent heat demand, the pump runs continuously except when control is in WWSD. When the DIP switch is set to external heat demand, the pump only operates when an external heat demand is applied and the control is not in WWSD. The pump symbol is shown while in the View menu and the pump is operating. Once the heat demand is removed, the pump continues to operate for the time set by the pump purge setting. During the pump purge, the pump symbol flashes while in the View menu.

Exercising

The control includes a feature which exercises the system pump and mixing valve in order to prevent corrosion and precipitate build-up due to prolonged periods of inactivity. If the pump has not run in the past 3 days, the pump will run for 10 seconds. If the mixing valve has not operated its full stroke in the past 3 days, the control will operate











the valve to the fully open position and then back to the fully closed position.

TEST will be displayed during exercising and can be exited by pressing the down  button.

Setting the Time


The control has an internal time clock. The time is maintained for at least 4 hours in the case of power loss. The time is visible in the 'TIME' menu only when DIP switch 1 is set to setback.

To set the time:

- 1) Press and release the Menu  button until the 'TIME' menu is found.
- 2) Press and release the Item  button. The minute numbers will flash. Press the up  or down  button to set the minutes.
- 3) Press and release the Item  button. The hour number will flash. Press the up  or down  button to set the hour.
- 4) Press and release the Item  button. The day of the week number will flash. Press the up  or down  button to set the day of the week.

Night Setback

- The control can also operate either one or two night setback channels. The night setback operates by opening or closing the timer 1 relay contact or the timer 2 relay contact at the event time. This causes thermostats to operate at their night setback temperature.
- When an indoor sensor and a permanent demand is present, the Timer 1 and Timer 2 contacts are disabled. Instead, there are up to four separate Indoor Target temperature settings.
- When the control is in single zone operation (Remote indoor sensor connected and DIP set to permanent demand), only channel 1 setback program is available. The channel 2 setback program is not shown and the control operates both the channel 1 relay and the channel 2 relay at the same time.
- The second night setback channel 'SCHD 2' can be set to one of three settings:
 - 1) CP1 = schedule 2 copies schedule 1 event times.
 - 2) On = setback schedule 2 is on and separate from schedule 1.
 - 3) OFF = setback schedule 2 is off.

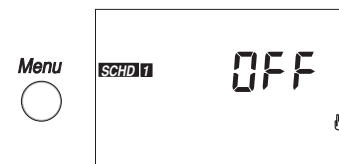

Manual Override

- Select a manual override to prevent the scheduled event from happening.

OFF = operate on scheduled night setback. This is the default setting.

Temporary Wake *TMPY* = temporarily operate at the Indoor Target Wake temperature or close the timer contact for 3 hours.

Permanent Wake *PERM* = permanently operate at the Indoor Target Wake temperature or close the timer contact.

Temporary Unoccupied *TMPY* = temporarily operate at the Indoor Target Unoccupied temperature or close the timer contact for 3 hours.

Permanent Unoccupied *PERM* = permanently operate at the Indoor Target Unoccupied temperature or close the timer contact.

Temporary Occupied *TMPY* = temporarily operate at the Indoor Target Occupied temperature or close the timer contact for 3 hours.

Permanent Occupied *PERM* = permanently operate at the Indoor Target Occupied temperature or close the timer contact.

Temporary Sleep *TMPY* = temporarily operate at the Indoor Target Sleep temperature or close the timer contact for 3 hours.

Permanent Sleep *PERM* = permanently operate at the Indoor Target Sleep temperature or close the timer contact.

Away = operate the indoor target at 17.0 °C (62.5°F) or close the timer contact. When using outdoor reset, the warm weather shut down occurs at 17.0°C (62.5 °C).

MODE

- Select how many night setback events should occur each day.

OFF = no night setback

2 = 2 setback events per day: ,

4 = 4 setback events per day: , , ,

TYPE



- Select the type of repeating schedule.


24 hr= schedule repeats every 24 hours.

5-11 = schedule repeats every week. The 5 weekdays event times are grouped together. Saturday and Sunday have separate event times.

7dAY = schedule repeats every week. There are separate event times for each day.


Setting Event Times

- For each scheduled setback event, a time between 00:00 and 23:50 must be set.
- If it is desired to skip the scheduled setback event, set the event time to --:--.
- :-- is found between 23:50 and 00:00.

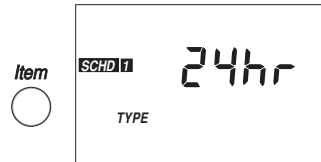

Temporary Override

- When an indoor sensor is present, the desired indoor temperature can be temporarily overridden by pressing the up or down button.




- The temporary override remains in effect for 3 hours.
- To cancel the temporary override, press and hold the up and down buttons together.

Wiring


- Only qualified and competent personnel should attempt installation of the control.
- The power supply must be disconnected before starting with the installation.
- All wiring as per local electrical codes.
- Use 18 AWG (0.75 mm²) wire and marrettes to extended sensor wires if needed.
- All wires are to be stripped to a length of 3/8" (9 mm) to ensure proper connection.

Input / Output	Mixing Control 31355 Terminal	Wire Voltage	Connects To...	On Device...
24 V (ac) Floating Action	1	Switched "C"	Open	Mixing Valve Motor 58130, 58150 or 58199
	2	"R"	Common	
	3	Switched "C"	Close	
0 - 10 V (dc)	1	"C"	Blk	DDC Actuator 56121
	2	"R"	Blu	
	3	Analog signal	Red	
2 - 10 V (dc)	1	"C"		3 rd Party Actuator
	2	"R"		
	3	Analog signal		
Timer 1 ⌚	4	Switched "R"	Timer ⌚ 1	StatLink® module 40226 (Optional)
Timer 2 ⌚	5	Switched "R"	Timer ⌚ 2	StatLink® module 40226 (Optional)
Indoor Sensor	6	Analog signal	Sensor wire	Indoor Sensor 30076 (Optional)
	7	Analog signal	Sensor wire	
Mix Sensor	8	Analog signal	Sensor wire	Mix Sensor 30071
	9	Analog signal	Sensor wire	
Outdoor Sensor	9	Analog signal	Sensor wire	Outdoor Sensor 30070
	10	Analog signal	Sensor wire	
Power	11	"C"	C	Transformer
	12	"R"	R	
Pump Signal	12	"R"	2	24Vac Pump Relay 45112
	13	Switched "C"	7	
External Demand	15	24V	Dry contact	StatLink® module 40226
	16	24V	Dry contact	
Boiler	17	24V (external)	T	Boiler
	18	24V (external)	T	

31355 Wiring for Outdoor Reset Multizone Operation or Setpoint Operation with StatLink®

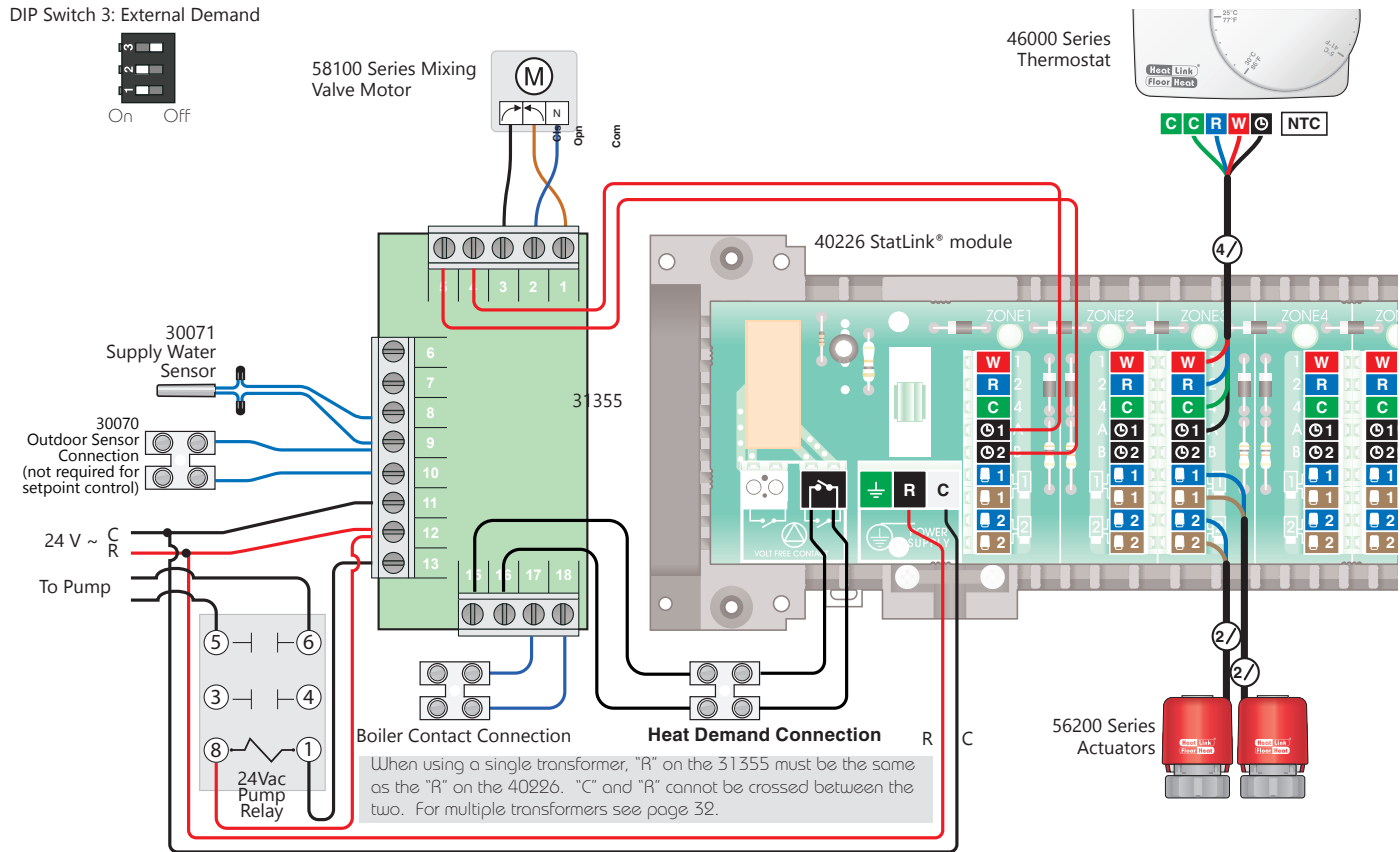


31355 Wiring for Outdoor Reset Multizone Operation or Setpoint Operation without StatLink®

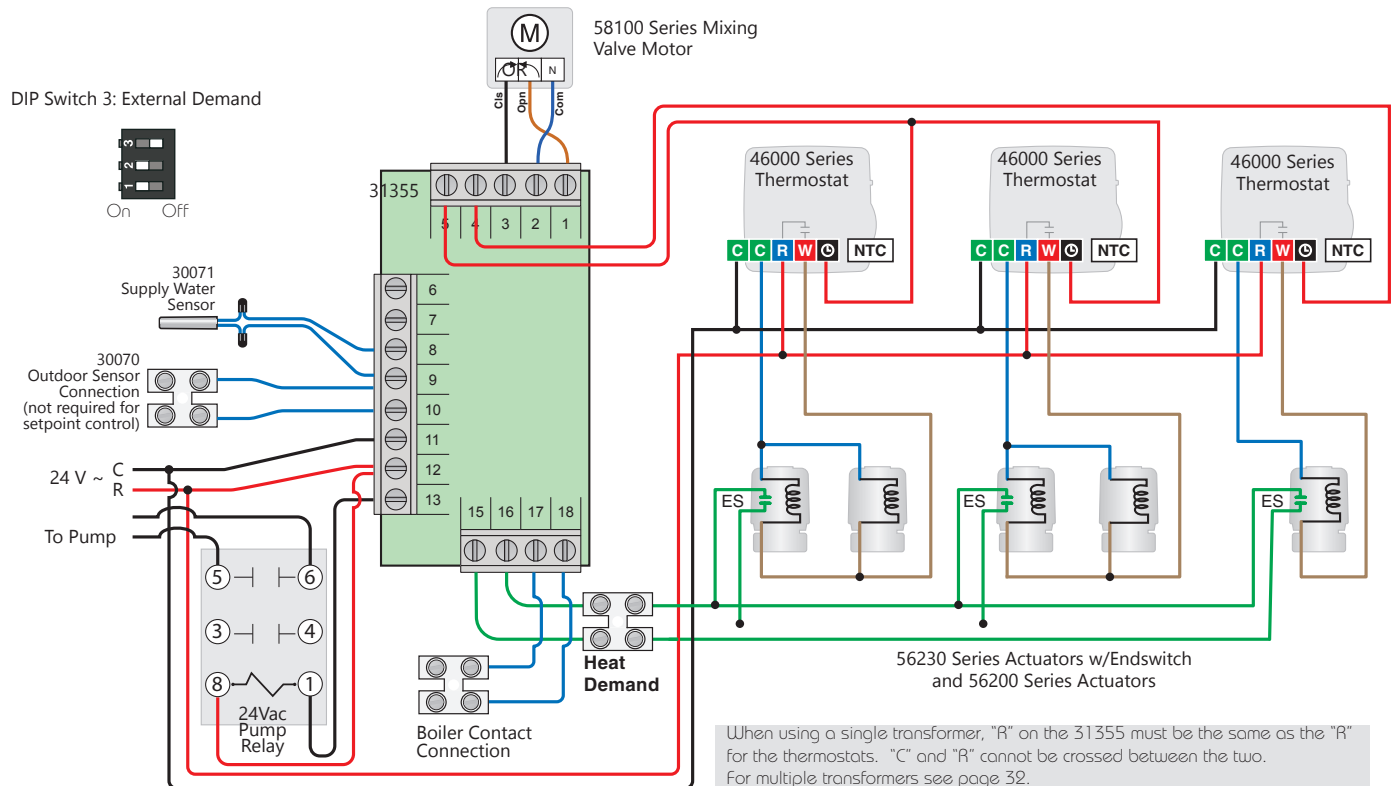

31355 Wiring for Outdoor Reset Single Zone Operation or Setpoint Operation

DIP Switch 3: Permanent Demand



58100 Series Mixing Valve Motor



46000 Series Thermostat (optional)



30076/77 Indoor Sensor (not required for setpoint control)



30071 Supply Water Sensor







30070 Outdoor Sensor Connection (not required for setpoint control)



24 V ~ C R

To Pump

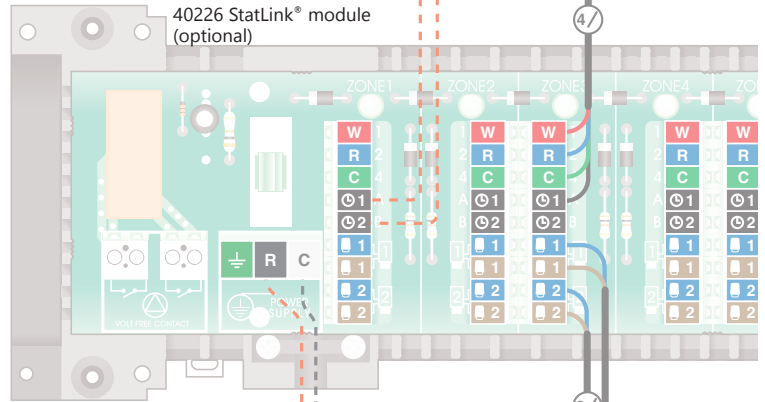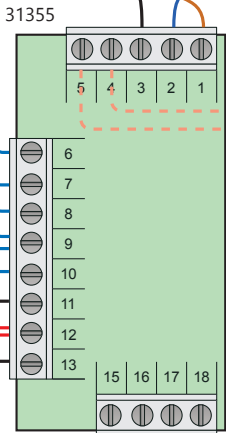


When using a single transformer, "R" on the 31355 must be the same as the "R" on the 40226. "C" and "R" cannot be crossed between the two. For multiple transformers see page 32.

56200 Series Actuators (optional)




Using Multiple Transformers - Floating Neutral Transformers

Transformers where there is no connection between primary and secondary wiring or between ground and secondary wiring.

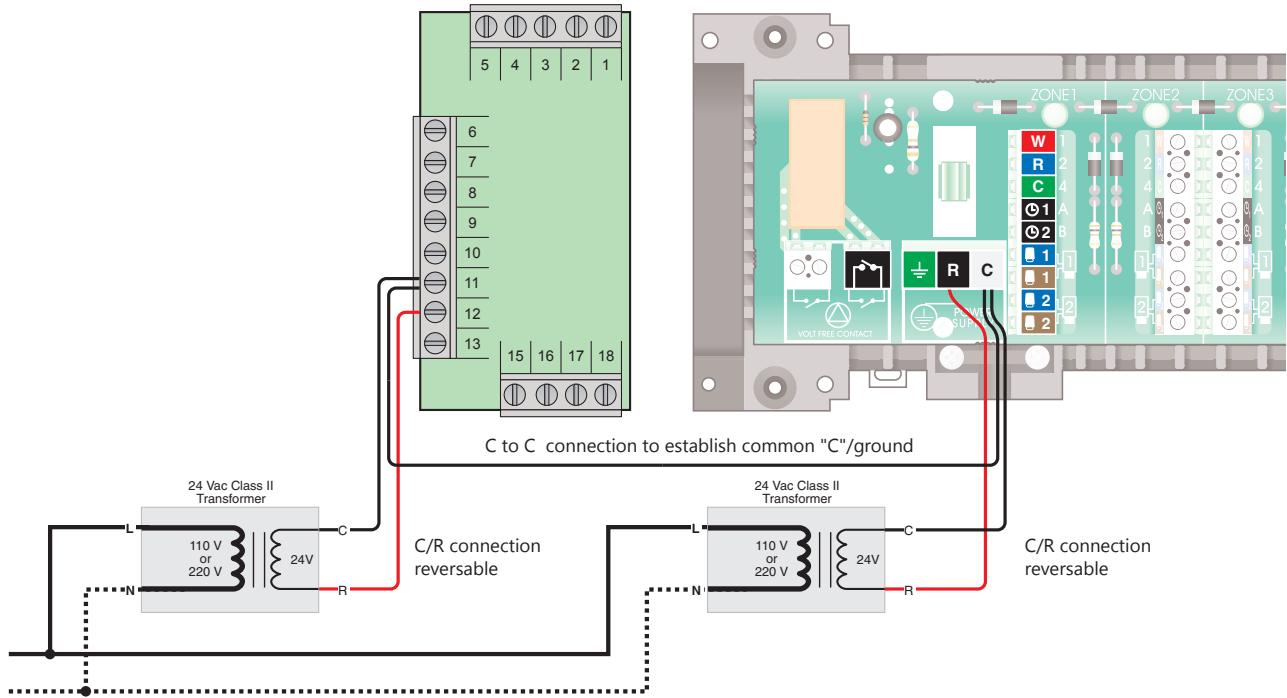

Using Multiple Transformers - Polarized or Grounded Transformers

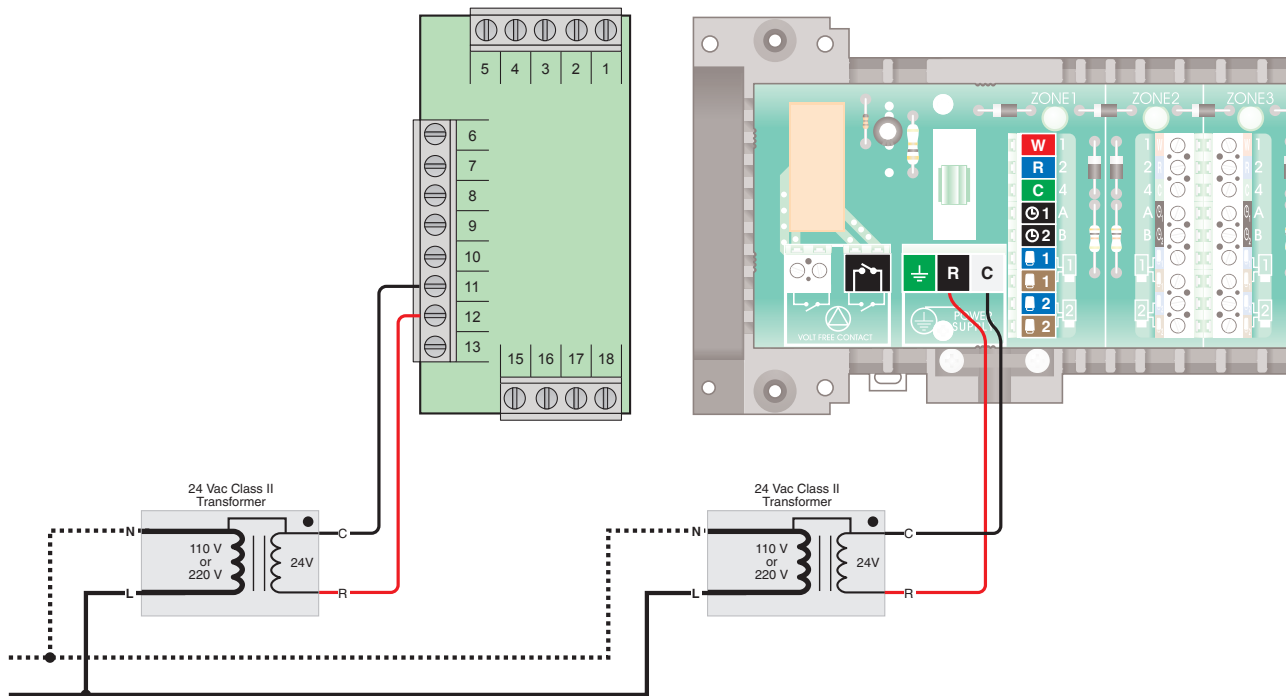

Transformers with a "C" to "N" or "C" to ground connection.



Cleaning the Control


The control's exterior can be cleaned using a damp cloth. Moisten the cloth with water and wring out prior to wiping the control. Do not use solvents or cleaning solutions.







Testing

- The control includes a test sequence that operates each of the control's outputs.
- Use the test sequence for troubleshooting the control operation and the wiring.
- When a Demand is present, each step can be paused for 5 minutes by pressing and releasing the down  button.
- Press the down  button to cancel the pause and resume the test sequence.

To Start the Field Test Sequence:

- 1) Set DIP switch 2 to Unlocked.
- 2) Press the Menu button to enter the Adjust menu.
- 3) Set the Access level item to Advanced (Ad) or Installer (InS).
- 4) Set the Test item to 'FLd'.



Step 1	Open the mixing valve to the fully open position over the motor speed setting.	
Step 2	Close the mixing valve to the fully closed position over the motor speed setting.	
Step 3	The pump is activated and remains on until the end of Step 4.	
Step 4	Close boiler relay contact for 10 seconds.	
Step 5	If channel 1 relay operational, close timer channel 1 relay contact for 10 seconds.	
Step 6	If channel 2 relay operational, close timer channel 2 relay contact for 10 seconds.	

Max Heat Feature (heat demand must be present)

- Use the Max Heat feature for purging air from the system and system start up.
- The mixing valve maintains the Mix Maximum temperature as the mix target at the mixing valve outlet.
- The WWSD is disabled.
- The system pump is active.
- The Max Heat lasts for 24 hours and then automatically times out.







To start the 'MAX HEAT' feature:

- 1) Set DIP switch 2 to Unlocked.
- 2) Press the Menu button to enter the Adjust Menu.
- 3) Set the Access level to Advanced (Ad) or Installer (InS).
- 3) Set the Test item to 'MAN'.




To cancel the 'MAX HEAT' feature:

- Set the Test item to 'OFF'.

ERROR MESSAGES (1 OF 2)

Error Message	Description
	<p>CONTROL ERROR</p> <ul style="list-style-type: none"> There is an internal control problem. The Adjust menu default settings have been loaded into memory. The control stops operation until settings are checked by the installer. <p>To correct the error:</p> <ol style="list-style-type: none"> Set the control to the Advanced access level. Check all items in the 'Adjust' menu.
	<p>SCHEDULE 1 ERROR</p> <ul style="list-style-type: none"> There is an internal control problem. The default schedule 1 settings have been loaded into memory. The control continues operation without using the setback schedule. <p>To correct the error:</p> <ol style="list-style-type: none"> Set the control to the Advanced access level. Check all items in the 'Schedule 1' menu.
	<p>SCHEDULE 2 ERROR</p> <ul style="list-style-type: none"> There is an internal control problem. The default schedule 2 settings have been loaded into memory. The control continues operation without using the setback schedule. <p>To correct the error:</p> <ol style="list-style-type: none"> Set the control to the Advanced access level. Check all items in the 'Schedule 2' menu.
	<p>OUTDOOR SENSOR SHORT CIRCUIT</p> <ul style="list-style-type: none"> The control continues to operate and assumes a temperature of 0°C. Check the outdoor sensor resistance reading using an ohmmeter. Compare the resistance reading to the temperature chart in the L630070. Check for short circuits along the outdoor sensor wires. The error message is cleared once the outdoor sensor short circuit is corrected and one of the buttons is pressed.
	<p>OUTDOOR SENSOR OPEN CIRCUIT</p> <ul style="list-style-type: none"> The control continues to operate and assumes a temperature of 0°C. Check the outdoor sensor resistance reading using an ohmmeter. Compare the resistance reading to the temperature chart in the L630070. Check for loose connections and broken wires along the outdoor sensor wires. The error message is cleared once the outdoor sensor open circuit is corrected and one of the buttons is pressed.
	<p>MIX SENSOR SHORT CIRCUIT</p> <ul style="list-style-type: none"> The control continues to operate the mixing valve at a fixed output. Check the mix sensor resistance reading using an ohmmeter. Compare the resistance reading to the temperature chart in the L630070. Check for short circuits along the mix sensor wires. The error message is cleared once the mix sensor short circuit is corrected and one of the buttons is pressed.

ERROR MESSAGES (2 OF 2)

Error Message	Description
	<p>MIX SENSOR OPEN CIRCUIT</p> <ul style="list-style-type: none"> • The control continues to operate the mixing valve at a fixed output. • Check the mix sensor resistance reading using an ohmmeter. • Compare the resistance reading to the temperature chart in the L630070. • Check for loose connections and broken wires along the mix sensor wires. • The error message is cleared once the mix sensor open circuit is corrected and one of the buttons is pressed.
	<p>INDOOR SENSOR SHORT CIRCUIT</p> <ul style="list-style-type: none"> • The control continues to operate, but with no indoor feedback. • Check the indoor sensor resistance reading using an ohmmeter. • Compare the resistance reading to the temperature chart in the L630070. • Check for short circuits along the indoor sensor wires. • The error message is cleared once the indoor sensor short circuit is corrected and one of the buttons is pressed.
	<p>INDOOR SENSOR OPEN CIRCUIT</p> <ul style="list-style-type: none"> • The control continues to operate, but with no indoor feedback. • Check the indoor sensor resistance reading using an ohmmeter. • Compare the resistance reading to the temperature chart in the L630070. • Check for loose connections and broken wires along the indoor sensor wires. • The error message is cleared once the indoor sensor open circuit is corrected and one of the buttons is pressed.

Piping Options

For all options hot water migration/gravity flow is possible in the supply riser. Unless the load has a positive shut off, a Flow check or Spring loaded check valve is required.



Option #1: Parallel Primary/Secondary

Pros:

- Supply water temperature the same for each load
- No possible pump interference

Cons:

- Requires additional balancing valves for each load take off.
- Hot water migration/gravity flow possible in return riser. Flow check, Spring loaded check valve or thermal trap required in return riser.
- Critical on site installation (Tee spacing and pipe sizing)
- Complex piping

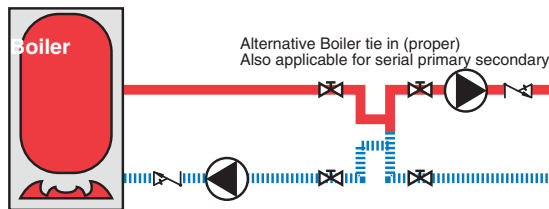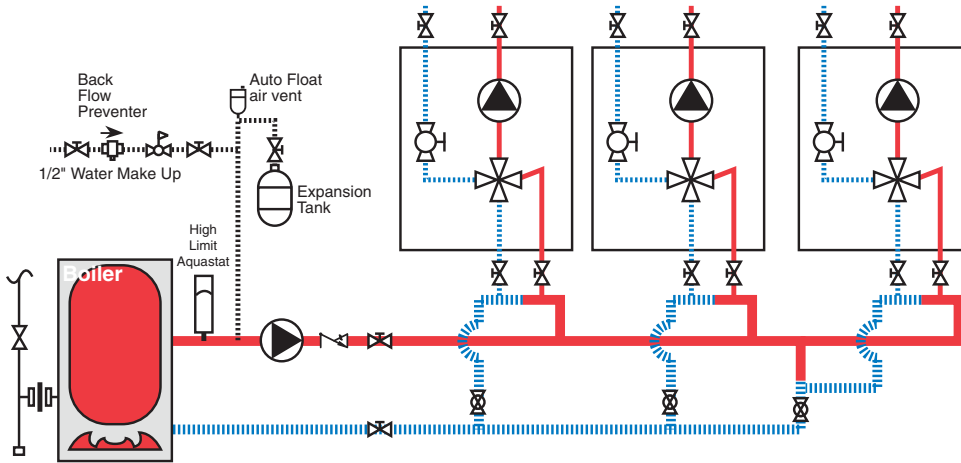

Proper Primary/Secondary piping (shown as alternative boiler tie in), requires an additional pump and triple (rather than the much more common double) pole relays (see page 22).


Option #2: Series Primary/Secondary

Pros:

- Automatic priority
- No possible pump interference

Cons:

- Supply water temperature lowers for each load, this change of temperature is not constant. Some loads may not function if temperature is too low.
- Very expensive to alter priority sequence (note: all loads are prioritized)
- Hot water migration/gravity flow possible in return line. Flow check, Spring loaded check valve or thermal trap required in return riser.
- Critical on site installation (Tee spacing and pipe sizing)

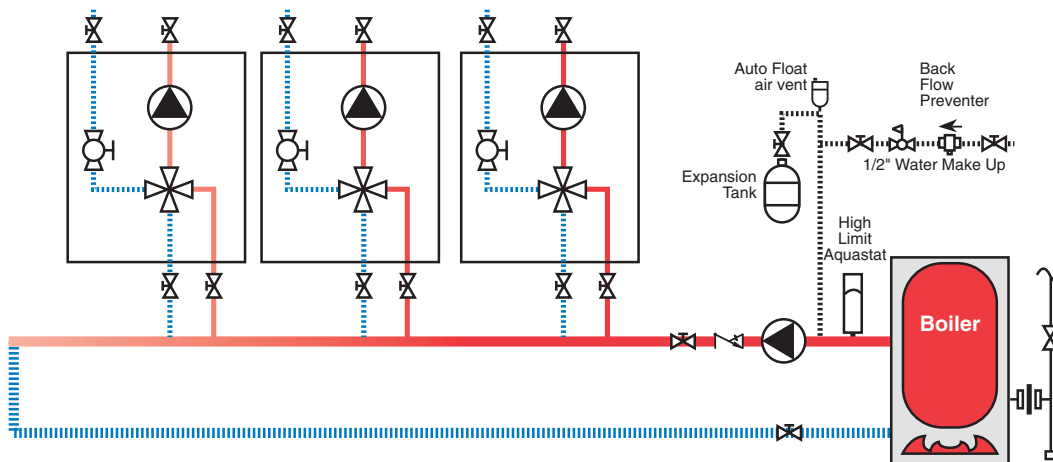

Troubleshooting

Problem	Check / Verify	Possible Cause
Low System Water Temperature	The electronic actuator fails to open during a call for heat	The electronic actuator may be improperly seated or may be defective. Replace if necessary.
	Wiring from panel to control.	Check that the wiring is done properly. Consult qualified electrician prior to alteration of wiring between heat source and panel.
	Output of heat source is unable to meet demand of heating system.	Compare output of heat source to the requirements of the heating system.
	Circulator is not on during a call for heat. (Use a stethoscope or similar device to verify)	The circulator may be defective.
	Boiler is locked out.	Reset boiler.

Maintenance

Yearly maintenance should be done on the panel prior to each heating season to ensure the efficient and accurate operation of the panel.

Complete the following check list:

- Raise all thermostats to cause a call for heat within the system. Verify that the circulator starts, via a stethoscope or similar device.
- Have the controls exercise the mixing valve and mixing valve motor.
- Return all thermostats to a desirable setting.

You are now ready for another heating season with HeatLink.




Heat Link® Canada

Manufactured & distributed by HeatLink Group Inc.

Head Office:

4603E - 13th Street N.E.
Calgary, Alberta, T2E 6M3


Toll Free: 1-800-661-5332
International Phone: +1 (403) 250-3432
Fax: 1-866-450-1155



Heat Link® China

Distributed by Cathay-Links International


Phone: 852-25693213
Fax: 852-25359271



Heat Link® Ireland

Distributed by Jamoni Ltd.


Phone: 057 - 932 4062
Fax: 057 - 932 4063
Freephone: 1800-311338



Heat Link® México

Distributed by Distribuidora Caisa S.A. de C.V.

Phone: (52-55) 3300-4400
Fax: (52-55) 3300-4406



Heat Link® United States

Distributed by HeatLink Group Inc.

USA Distribution Center:

1000 - 100th Street SW, Suite B
Byron Center, MI, 49315

Toll Free: 1-800-661-5332
Fax: 1-800-869-6098



info@heatlink.com
www.heatlink.com