

|   |         |
|---|---------|
| Job or Customer :   |         |
| Location :  |         |
| Engineer :  |         |
| <input type="checkbox"/> Complies with Spec<br><input type="checkbox"/> Alternate | Notes : |
| Contractor :  |         |
| HeatLink Rep :  |         |
| Submitted By :  | Date :  |
| Approved By :   | Date :  |
| P.O. Number :   | Date :  |


### Description

Open on both ends with 3/4" PEX insert connections. 1/2" branches in single row.

*The use of PEX tubing in a potable hot-water plumbing system with an operating temperature above 140°F (60°C) or system pressure above 80 psig (550 kPaG) or highly aggressive water quality or any combination thereof can significantly reduce the service life of the tubing.*

*HeatLink requires following the guidelines described in Plastics Pipe Institute TN-53, Guide to Chlorine Resistance Ratings of PEX Pipes and Tubing for Potable Water Applications and HeatLink INFO 37, Domestic Hot Water Recirculation Systems.*

| Qty | Stk. # | # of ports | Inlet | Outlet | A               | B               | Weight lb/(kg)         |
|-----|--------|------------|-------|--------|-----------------|-----------------|------------------------|
|     | 14202M | 2          | 3/4"  | 3/4"   | 3.95<br>(100.4) | 2.53<br>(64.3)  | 0.039 lb<br>(0.018 kg) |
|     | 14203M | 3          | 3/4"  | 3/4"   | 5.68<br>(144.1) | 4.26<br>(108.1) | 0.058 lb<br>(0.026 kg) |
|     | 14204M | 4          | 3/4"  | 3/4"   | 7.40<br>(187.9) | 5.98<br>(151.9) | 0.076 lb<br>(0.035 kg) |

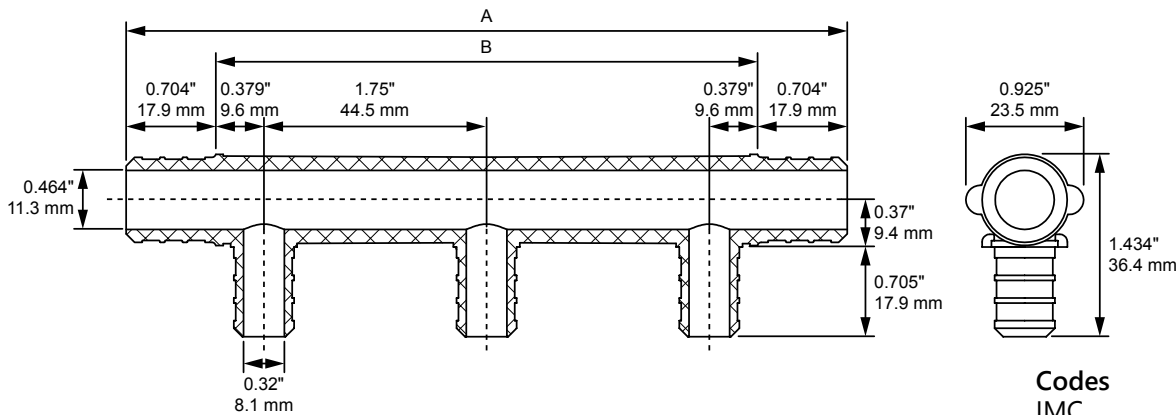

### Technical Data

|                           | Specifications                      |
|---------------------------|-------------------------------------|
| Material                  | Modified Polyphenylsulfone          |
| Operating pressure rating | 180°F @ 100 psi (82.2°C @ 0.69 MPa) |

### Listings

|                 |               |
|-----------------|---------------|
| ICC-ES PMG 1087 | NPC of Canada |
| cNSFus-pw       | NSPC          |
| cQAlus P371     | UMC           |
| U.P. Code       | UPC           |

### Standards

|              |
|--------------|
| ASTM E84     |
| ASTM F877    |
| ASTM F2159   |
| CSA B137.5   |
| NSF/ANSI 14  |
| NSF/ANSI 61  |
| NSF/ANSI 372 |
| ULC S102.2   |

### Installation

Installation must follow all of HeatLink's instructions and guidelines.

### Related Documents

- Operation and Maintenance Manual (L6SSTLx000x)
- HeatLink Limited Heating Warranty