

Job or Customer :	
Location :	
Engineer :	
<input type="checkbox"/> Complies with Spec <input type="checkbox"/> Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

### Description

The StatLink Wireless Module for eight-zone radiant floor heating with wireless communication. Zones are controlled by Wireless Digital Thermostats.

#### Features:

- Can be used with NO or NC thermal actuators.
- Terminals for three actuators per zone.
- Pump dry contact 3 min on/off delay.
- Boiler dry contact 3 min on delay and 0 or 15 min off delay.
- Contacts for heating/cooling changeover, and humidity sensor.
- Plug-in connections.
- LED status indication.
- Strain relief fittings.
- USB plug to provide power to a Co-ordinator
- Optional external antenna.

Includes 13 ¾" (35 cm) DIN rail and mounting screws.

Qty	Stk. #	Weight
	40328	1.6 lb (0.72 kg)

### Technical Data

#### Specifications



Controls	Reset (pinhole button) Network button
Indicators	8× Zone LED Boiler enable LED Pump enable LED Power LED Heat/Cool LED Network LED Group 1 LED Group 2 LED
Configuration Switches	NC / NO Actuators 0 / 15 min boiler off delay Internal / External antenna
Operating Conditions	32 – 122°F (0 – 50°C) 5 – 95% RH, non condensing
Storage Conditions	-4 – 140°F (-20 – 60°C) 5 – 95% RH, non condensing
Power	24 Vac~, 60Hz
Fuse	4 A 5×20mm F4AH250VP
Total Load Max.	24 Vac~, 2 A
Pump Load Max.	24V~, ½ HP
Boiler Load Max.	24V~, 3A (resistive)

#### Standards / Listings

FCC ID: 2AG86-SAA6DW1

IC: 21063-SAA6DW1

## Dimensions

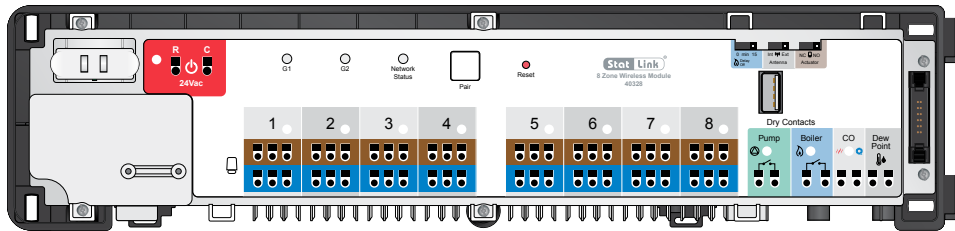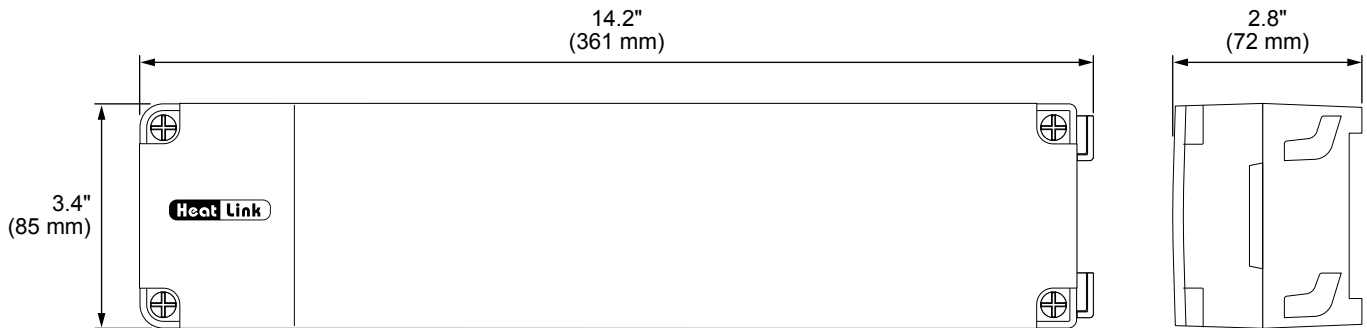

## Installation

Installation must follow all of HeatLink's instructions and guidelines.

## Maintenance

Maintenance must follow all of HeatLink's instructions and guidelines.

## Related Documents

- Smart System Installation & Setup Manual (L3715)
- StatLink 8 Zone Wireless Module Instructions (L640328)
- HeatLink Limited Heating Warranty