

| Job or Customer : | | | | |
|---------------------------------|---------|--------|--|--|
| Location : | | | | |
| Engineer: | | | | |
| ☐ Complies with Spec☐ Alternate | Notes : | | | |
| Contractor: | | | | |
| HeatLink Rep : | | | | |
| Submitted By : | | Date : | | |
| Approved By : | | Date : | | |
| P.O. Number: | | Date : | | |

Description


No lead brass ³/₄" PEX F1960 × ³/₄" MNPT full port straight ball valves with butterfly handle.

The use of PEX tubing in a potable hot-water plumbing system with an operating temperature above 140°F (60°C) or system pressure above 80 psig (550 kPaG) or highly aggressive water quality or any combination thereof can significantly reduce the service life of the tubing.

HeatLink requires following the guidelines described in Plastics Pipe Institute TN-53, Guide to Chlorine Resistance Ratings of PEX Pipes and Tubing for Potable Water Applications and HeatLink INFO 37, Domestic Hot Water Recirculation Systems.

| | | | Dimension, in/(mm) | | | | | | |
|-----|-----------|-----------------|--------------------|----------------|----------------|----------------|----------------|----------------|-----------------|
| Qty | Stk. # | Size | Α | В | С | D | E | ID | Weight, lb/(kg) |
| | EX23822NL | ³⁄₄" MNPT x PEX | 1.22 (31) | 2.43 (61.8) | 2.24 (56.8) | 2.85 (72.3) | 1.22 (30.9) | 0.61 (15.5) | 0.49 (0.220) |

| Technical Data | Specifications | | | | |
|---------------------------|--|---------------------------|--|--|--|
| Materials | Body | No Lead (C46500) Brass | | | |
| | Seat | PTFE | | | |
| | Ball | Stainless steel | | | |
| | Packing | PTFE NBR | | | |
| | O-ring | | | | |
| | Stem | Brass | | | |
| | Handle nut | Plated steel | | | |
| | Lock washer | Plated steel | | | |
| | Handle | Aluminum alloy | | | |
| | Packing nut | Brass | | | |
| | Cap | No Lead (C46500) Brass | | | |
| Operating pressure rating | 180°F @ 100 psi (82.2°C @ 0.69 MPa) | | | | |
| | | | | | |

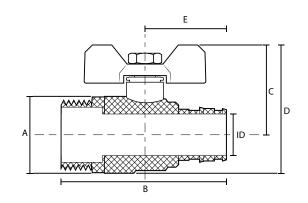

| Standards | | |
|----------------------|--|--|
| ASTM F1960 compliant | | |
| IAPMO/ANSI Z1157 | | |
| NSF/ANSI 14 | | |
| NSF/ANSI 61 | | |
| NSF/ANSI 372 | | |
| | | |

Installation

Installation must follow all of HeatLink's instructions and guidelines.

Related Documents

· HeatLink Limited Plumbing Warranty